

Job Name/Location:

Tag No.:

Date:

For: File Resubmit

PO No.:

Approval Other_____

Architect:

GC:

Engr:

Mech:

Rep:

(Company)

(Project Manager)

PRHR083A

Multi V™ Heat Recovery Unit

Eight (8) Port



Performance:

| | |
|---|---------|
| Maximum Port Capacity Btu/h (each port) ¹ | 60,000 |
| Maximum Unit Capacity Btu/h (sum of ports) | 230,000 |
| Number of Indoor Unit Ports | 8 |
| Max. Connectible Number of Indoor Units | 64 |
| Max. Connectible Number of Indoor Units per Branch Power Input ² | 8 |
| Cooling | 75.9 |
| Heating | 72.1 |

Refrigerant Piping:³

| | |
|------------------------------------|-------|
| Port Liquid Line (in., O.D.) | 3/8 |
| Port Vapor Line (in., O.D.) | 5/8 |
| System Liquid Line (in., O.D.) | 5/8 |
| System Vapor Line High (in., O.D.) | 7/8 |
| System Vapor Line Low (in., O.D.) | 1-1/8 |

Features:

- Allows connected indoor units to be in cooling or heating mode simultaneously.
- Internal components are insulated.
 - External casing insulation is not needed.³
 - Condensate drain not needed.
- Series or parallel connection with additional heat recovery units.
- Flexible placement for service access or pipe routing.
- Access panels:
 - Top panel for EEV heads.
 - Rear panel for control access.
 - Bottom panel for refrigerant circuit.

Electrical:²

| | |
|-----------------------|--------------|
| Power Supply (V/Hz/Ø) | 208-230/60/1 |
| Rated Amps | 0.09 |

Unit Data:

| | |
|-------------------------------|-------|
| Refrigerant Type | R410A |
| Refrigerant Control | EEV |
| Sound Pressure | |
| Cooling Mode dB(A) | 31 |
| Heating Mode dB(A) | 31 |
| Simultaneous dB(A) | 38 |
| Changeover Cooling to Heating | 33 |
| Changeover Heating to Cooling | 38 |
| Unit Net Weight (lbs.) | 68 |
| Unit Shipping Weight (lbs.) | 82 |

Notes:

1. Each port can allow up to 8 indoor units with a maximum capacity of 60 MBh per port.
2. Power wiring is field provided, and must comply with the applicable local and national codes.
3. All refrigerant piping requires insulation.
4. Communication cable between Master outdoor units to indoor units / heat recovery units to be 18 AWG, 2-conductor, twisted, stranded, shielded. Ensure the communication cable shield is properly grounded to the Master outdoor unit chassis only. Do not ground the outdoor unit to indoor units / heat recovery units communication cable at any other point. Wiring must comply with all applicable local and national codes.
5. Kit components must be kept dry and free of debris before installation.
6. This unit comes with a dry nitrogen charge.
7. Must follow installation instructions in the applicable LG installation manual.






PRHR083A
Multi V™ Heat Recovery Unit
Eight (8) Port



Tag No.: _____
Date: _____
PO No.: _____

| | |
|-----|-----------|
| W | 31-1/4" |
| H | 8-5/8" |
| D | 18-15/16" |
| L1 | 6-5/16" |
| L2 | 6-15/16" |
| L3 | 3/4" |
| L4 | 6-5/16" |
| L5 | 2-3/16" |
| L6 | 8-1/16" |
| L7 | 6-7/8" |
| L8 | 2-5/16" |
| L9 | 8-9/16" |
| L10 | 6-3/16" |
| L11 | 3-9/16" |
| L12 | 2" |
| M1 | 4-15/16" |
| M2 | 12-1/4" |
| M3 | 1-1/2" |
| M4 | 31-7/8" |

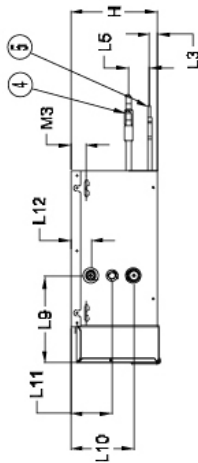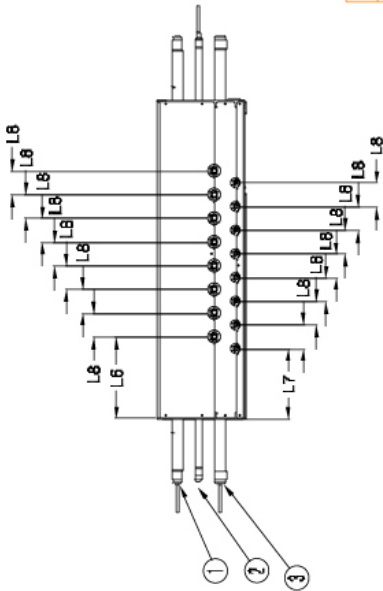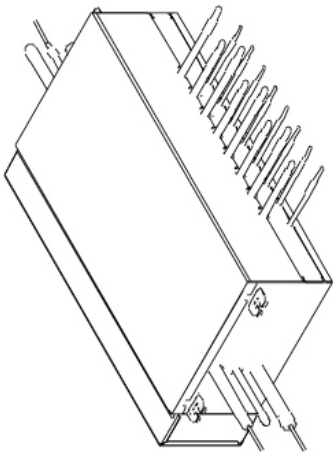

| | |
|-----|-----------------------------|
| 5 | Control box |
| 5 | Liquid pipe to Indoor unit |
| 4 | Gas pipe to Indoor unit |
| 3 | Low pressure gas pipe |
| 2 | Liquid pipe to Outdoor unit |
| 1 | High pressure gas pipe |
| No. | Part Name |

[Unit: inch]

Note
1. Unit should be installed in compliance with the installation manual in the product box.
2. Unit should be grounded in accordance with the local regulations or applicable national codes.
3. All electrical components and materials to be supplied from the site must comply with the local regulations or international codes.