Job Name/Location: Tag #: Date: For: File Resubmit PO No.: Approval Other GC: Architect: Mech: Engr: Rep: (Company (Project Manager) LVN181HV4 Multi F Vertical Air Handling Unit 18,000 Btu/h Indoor Unit Performance: **Operating Range:** Nominal Cooling Capacity (Btu/h) Cooling (°F WB) 18,000 Nominal Heating Capacity (Btu/h) Heating (°F DB) 20.000 Cooling Nominal Test Conditions: Heating Nominal Test Conditions: **Unit Data:** Indoor: 80°F DB/67°F WB Indoor: 70°F DB/60°F WB Refrigerant Type Outdoor: 95°F DB/75°F WB Outdoor: 47°F DB/43°F WB **Electrical:** Refrigerant Control Power Supply (V1/Hz/Ø) Sound Pressure<sup>3</sup> H/M/L 208-230 / 60 / 1 Rated Amps (A) Net Unit Weight (lbs) Shipping Weight (lbs) Piping: Fan: Installed Liquid Pipe (in., O.D.) ø1/4 Installed Vapor Pipe (in., O.D.) ø1/2 Type Liquid Connection (in., O.D.) ø3/8 Quantity Vapor Connection (in., O.D.) ø5/8 Motor/Drive ECM (Electronically Commutated Motor)/Direct Drain (In, ID) 3/4 FPT Airflow Rate H/M/L (CFM) 640 / 580 / 480 **Temperature Sensor** Thermistor Maximum External Static Pressure (in wg) **Standard Features:** • Filter Rack for Field Supplied Air Filter (16 x 20 x 1 inch) **Controls Features:** •W2 terminal connection •Inverter (variable speed fan) Group control Notes: Hot start Sleep mode Self diagnostics Acceptable operating voltage is 187V-253V. Soft dry (dehumidification) Timer (on/off) Wireless handheld remote controller requires an LG wired thermostat. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 1996. ·Weekly schedule Integrated dry contact for 3rd party See Engineering Manual for sensible and latent capacities. thermostat Controller sold separately All power/communication cable to be minimum 14 AWG, 4-conductor, stranded, shielded or unshielded, and must comply with applicable local and national code. If shielded, must be grounded •ECM fan provides constant airflow to the chassis at ODU only. regardless of permitted ESP **Optional Accessories:** Power wiring cable size must comply with the applicable local and national codes This unit comes with a dry helium charge. Simple Controller - PREMTC00U Corresponding refrigerant piping length is in accordance with standard length of each outdoor unit and the level difference is 0 ft. All capacities are net with a combination ratio between 95 - 105%. MultiSITE™ CRC1 Remote Controller - PREMTBVC0 Must follow installation instructions in the applicable LG installation manual. 10. Includes socket adapters for refrigerant pipe connections MultiSITE™ CRC1+ Remote Controller - PREMTBVC1 11. Electric heater accessory available in 3kW, 5kW, 8kW, and 10kW capacities. Refer to the engineering manual for details. Premium Remote Controller - PREMTA000 12. Controller not included ─ Wireless Handheld Remote Controller - PQWRHQ0FDB² AC Smart 5 - PACS5A000 ACP 5 - PACP5A000 LonWorks Gateway - PLNWKB100 RS3 Remote Controller- PREMTB100 Aux Heater Relay Kit- PRARHO Dry Contact Unit (1 contact, 24 VAC external power) - PDRYCB100 Dry Contact Unit (2 setpoint) - PDRYCB400 Jnitary Small HP AHRI Standard 210/240 Remote Button Temperature Sensor - ZRTBS01 3 kW Electric Heater - ANEH033B1<sup>11</sup> Wi-Fi Module - PWFMDD200

For a complete list of available accessories, contact your LG representative.

Downflow Kit - PNDFJ0

57-77

59-81

R410A

35 / 33 / 30


**EEV** 


123.5

135.1

Sirocco

## LVN181HV4 Multi F Vertical Air Handling Unit 18,000 Btu/h Indoor Unit



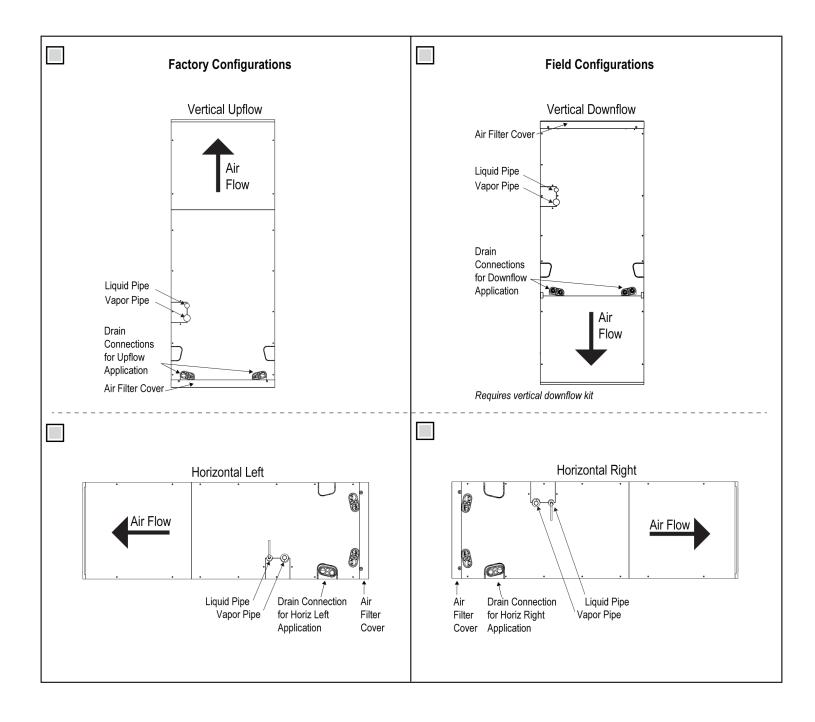



## LVN181HV4


Multi F Vertical Air Handling Unit

18,000 Btu/h Indoor Unit

Tag #:		
Date:		
PO No.:		



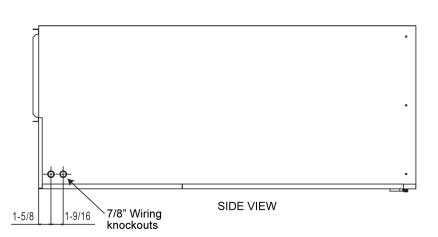

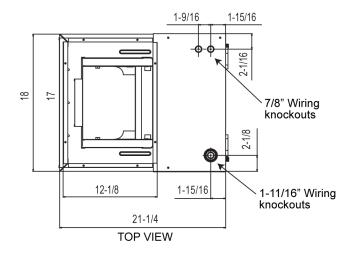



Unit: inches

Note: All measurements
have a tolerance of ±1/4 in.

