Job Name/Location: For: File Resubmit Date: PO No.: Approval Other GC: Architect: Mech: Engr: Rep: (Company (Project Manager) LVN360HV4 Multi F Vertical Air Handling Unit 36,000 Btu/h Indoor Unit Performance: Cooling (Min~Rated~Max, Btu/h) 14,000 ~ 36,000 ~ 44,000 Heating (Min~Rated~Max, Btu/h) 15,000 ~ 40,000 ~ 47,000 Cooling Nominal Test Conditions: Heating Nominal Test Conditions: Indoor: 80°F DB/67°F WB Indoor: 70°F DB/60°F WB Outdoor: 95°F DB/75°F WB Outdoor: 47°F DB/43°F WB **Electrical:** Power Supply (V1/Hz/Ø) 208-230 / 60 / 1 Rated Amps (A) 2.2 Piping: Installed Liquid Pipe (in., O.D.) ø3/8 Installed Vapor Pipe (in., O.D.) ø5/8 Liquid Connection (in., O.D.) ø3/8 Vapor Connection (in., O.D.) ø5/8 Drain (In, ID) 3/4 FPT **Temperature Sensor** Thermistor Standard Features: • Filter Rack for Field Supplied Air Filter (24 x 20 x 1 inch) **Controls Features:** •ESP control •Inverter (variable speed fan) Hot start Group control Self diagnostics Sleep mode Soft dry (dehumidification) Timer (on/off) ·Weekly schedule •Integrated dry contact for 3rd Controller sold separately party thermostat **Optional Accessories:** ☐ Simple Controller - PREMTC00U MultiSITE™ CRC1 Remote Controller - PREMTBVC0 MultiSITE™ CRC1+ Remote Controller - PREMTBVC1 Premium Remote Controller - PREMTA000 ☐ Wireless Handheld Remote Controller - PQWRHQ0FDB² AC Smart 5 - PACS5A000 ACP 5 - PACP5A000 LonWorks Gateway - PLNWKB100 AC Smart IV BACnet - PBACNA000 ACP IV BACnet Gateway - PQNFB17C2 Dry Contact Unit (1 contact, 24 VAC external power) - PDRYCB100 Dry Contact Unit (2 setpoint) - PDRYCB400 Remote Button Temperature Sensor - ZRTBS01 3 kW Electric Heater - ANEH033B1¹⁴ ─ Wi-Fi Module - PWFMDD200 Downflow Kit - PNDFK0



Operating Range:

Tag #:

Cooling (°F WB)	57-77
Heating (°F DB)	59-81

Unit Data:

Refrigerant Type	R410A
Refrigerant Control	EEV
Sound Pressure ³ H/M/L (±3 dB(A))	45/44/43
Net Unit Weight (lbs)	165
Shipping Weight (lbs)	188

Fan:

Туре		Sirocco		
Quantity		1		
Motor/Drive Brushless Digitally Controlled/Direct				
Airflow Rate H/M/L (CFM)		1,100 / 1,000 / 900		
External Static Pressure ^{4 5} (in wg)				
Minimum ESP/Fan Setting Value ⁶ 0.1/				
Maximum ESP/Fan	1.0/116			

Notes:


- Acceptable operating voltage is 187V-253V.
- Requires an LG wired thermostat
- Sound Pressure levels are tested in an anechoic chamber under ISO Standard 1996.
- Adjust fan speed to correct for static pressure increases when using field supplied air filter.
- At factory fan speed setting.
- Air flow rate (CFM) at high speed.
- See Engineering Manual for sensible and latent capacities.
- All power/communication cable to be minimum 18 AWG, 4-conductor, stranded, shielded or unshielded, and must comply with applicable local and national code. If shielded, must be grounded to the chassis at ODU only.
- Power wiring cable size must comply with the applicable local and national codes
- 10. This unit comes with a dry helium charge
- 11. Corresponding refrigerant piping length is in accordance with standard length of each outdoor unit and the level difference is 0 ft. All capacities are net with a combination ratio between 95 - 105%.
- 12. Must follow installation instructions in the applicable LG installation manual.
- Includes socket adapters for refrigerant pipe connections.
 Electric heater accessory available in 3kW, 5kW, 8kW, 10kW, 15kW, and 20kW capacities. Refer to the engineering manual for details.
- 15. Controller not included









LVN360HV4 Multi F Vertical Air Handling Unit 36,000 Btu/h Indoor Unit



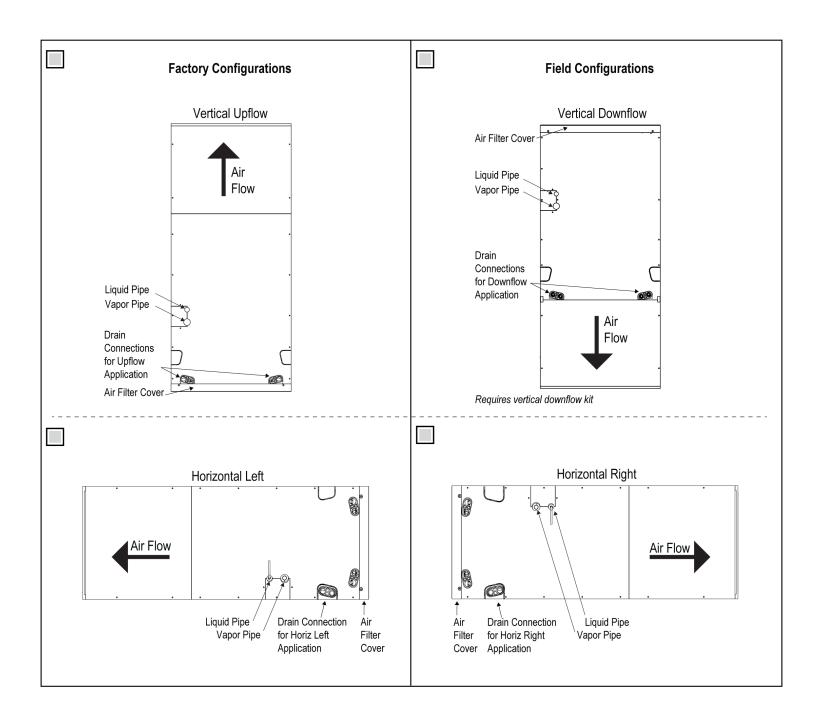

LVN360HV4 Multi F Vertical Air Handling Unit 36,000 Btu/h Indoor Unit

Tag #:		
Date:		
PO No.:		

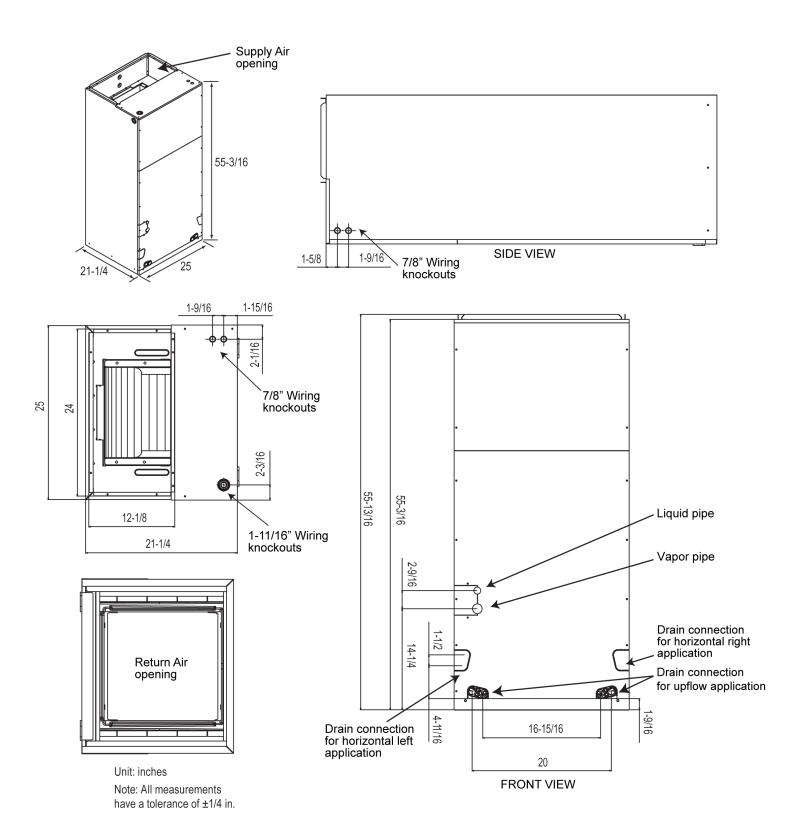

© LG Electronics U.S.A., Inc., Englewood Cliffs, NJ. All rights reserved. "LG Life's Good" is a registered trademark of LG Corp. /www.lghvac.com