Job	Name/	'Location:
-----	-------	------------

PO No.:

Architect:

Engr:

Rep: (Company)

LG181HSV3

Single Zone High Efficiency Standard Wall Mount Outdoor Unit (ODU) - LGU181HSV3, Indoor Unit (IDU) - LGN181HSV3

Performance:

Cool	ing:
------	------

Cooling Capacity	
(Min~Rated~Max) (Btu/h)	3,070 ~ 18,000 ~ 29,515
SEER	21.5
EER	12.58
SEER - Seasonal Energy Efficiency Ratio	EER - Energy Efficiency Ratio

Heating:

Heating Capacity (Min~Rated~Max) (Btu/h) HSPF	3,070 ~ 21,600 ~ 38,898 10.2
HSPF - Heating Seasonal Performance Factor Cooling Nominal Test Conditions:	Heating Nominal Test Conditions:

Indoor: 80°F DB / 67°F WB Outdoor: 95°F DB / 75°F WB

Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB

For:

GC:

Mech:

(Project Manager)

File

Approval

Outdoor Unit:

MOP (A)	20
MCA (A)	13
Cooling / Heating Rated Amps (A)	9.85 / 9.85
Compressor (A)	9.6
Fan Motor (A)	0.25
MOP - Maximum Overcurrent Protection	MCA - Minimum Circuit Ampacity

Total Power Input:

•	
Cooling Power Input (kW)	1.431
Heating Power Input (kW)	1.73

Piping:

Liquid Line (in., O.D.)	ø3/8
Vapor Line (in., O.D.)	ø5/8
Additional Refrigerant (oz./ft.)	0.38
Min. / Max. Pipe Length (ft.) ²	9.8 / 114.8
Piping Length (no add'l refrig., ft.)	24.6
Max. Elevation (ft.)	49.2

Controls Features:

• 24-Hour on/off timer • 4-Way auto swing • Auto changeover • Auto restart • Jet cool/Jet heat • Built-in low ambi- ent standard, down to 14°F (cooling mode)	 Condensate Sensor Connection Inverter (variable speed compressor) IDU compatible with Multi F ODUs Smart Diagnosis 3M Micro Filter 	 Self-cleaning indoor coil Sleep mode Cooling only function Built-in Wi-Fi via Smart ThinQ app Built-in base pan heater (9/12k; optional for 18k)
--	--	--

Optional Accessories:

☐ MultiSITE™ CRC1 - PREMTBVC0	AC Smart IV BACnet [®] Gateway -
MultiSITE CRC1+ - PREMTBVC1	PBACNA000
MultiSITE Comm. Mgr PBACNBTROA	ACP IV BACnet Gateway - PQNFB
PI-485 - PMNFP14A1	Base Pan Heater for 18k - PQSH1
Dry Contact - PDRYCB300	□ Low Ambient Wind Baffle Kit (Co
LonWorks [®] Gateway - PLNWKB100	to -40°C) - PAG-HS8 PAG-HS2 P

 Sleep mode
 Cooling only function
Built-in Wi-Fi via Smart

- e pan heater onal for 18k)





Resubmit

Other_



Operating Range: utdoor Unit

Tag #:

Outdoor Unit:	
Cooling (°F DB)	14 ~ 118
Heating (°F WB)	-4 ~ +65
Indoor Unit:	
Cooling (°F WB)	53 ~ 75
Heating (°F DB)	60 ~ 86
Electrical:	
Power Supply (V'/Hz/Ø)	208-230/60/1
System Data:	
Refrigerant Type	R410A
Refrigerant Control	EEV
Refrigerant Charge (lbs.)	3.53
ODU Sound Pressure	
(Cooling / Heating) (±3 dB[A]) ³	53 / 53
IDU Sound Pressure	
Cooling (H/M/L/Sleep) (±3 dB[A]) ³	45 / 40 / 35 / 29
Heating $(H/M/L) (\pm 3 \text{ dB}[A])^3$	45 / 40 / 35
ODU Net / Shipping Weight (lbs.)	116.8 / 126.5
IDU Net / Shipping Weight (lbs.)	26.5 / 34.8
Heat Exchanger Coating	GoldFin™
Fan:	
ODU Type	Propeller
IDU Type	Cross Flow
Fan Speeds (Fan/Cool/Heat)	6/6/6
Quantity (ODU + IDU)	1+1
Motor/Drive	Brushless Digitally Controlled/Direct
ODU Max. Air Flow Rate (CFM)	2,119
IDU Air Flow	
Cooling, Max/H/M/L (CFM)	706 / 530 / 477 / 371
Heating, Max/H/M/L (CFM)	706 / 547 / 494 / 371
Dehumidification (pts./hr.)	5.5

Notes:

Notes: 1. Acceptable operating voltage: 187V-253V. 2. Piping lengths are equivalent. 3. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745. 4. All communication / connection (power) cable from the outdoor unit to the indoor unit is field supplied and is to be minimum four-conductor, 18 AWG, stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only), and must comply with applicable local and national codes. 5. See Engineering Manual for sensible and latent capacities. 6. Power wiring cable size must comply with the applicable local and national code. 7. The indoor unit comes with a dry helium charge. 8. This data is rated 0 ft. above sea level, with 24.6 ft. of refrigerant line and a 0 ft. level difference between ourtdoor and indoor units.

Intertek

This Gala is facted of L. above sea fevel, with 24.6 ft. Of reingerant line and a Off. level difference between outdoor and indoor units.
 Must follow installation instructions in the applicable LG installation manual.
 Must follow installation Eds socket adapters for refrigerant pipe connections with Multi F systems.
 BACnet[®] is a registered trademark of ASHRAE. LonWorks[®] is a trademark of Echelon Corporation.

LGECI_Submittal_LG181HSV3_201807







BACNA000 CP IV BACnet Gateway - PQNFB17C2 Base Pan Heater for 18k - PQSH1201 Low Ambient Wind Baffle Kit (Cooling to -40°C) - PAG-HS8, PAG-HS2, PQCA0

For a complete list of available accessories, contact your LG representative.

Complete instant advantage accessing, contact your to represent accessing accessing accessing of the present of the prese



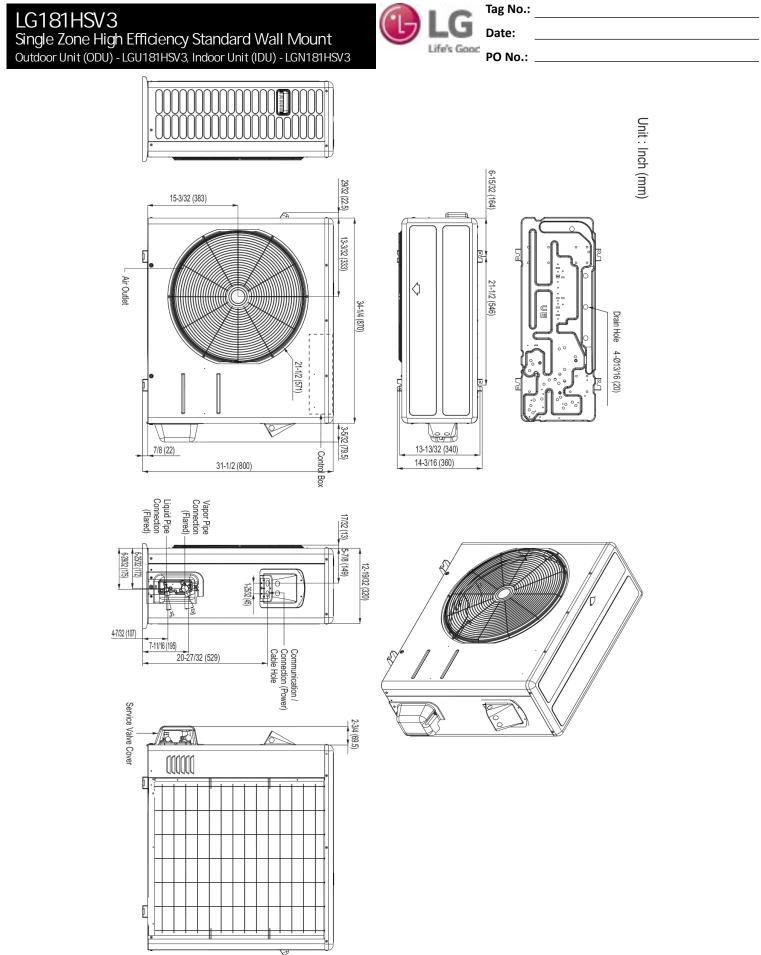

For continual product development, LG reserves the right to change specifications without notice. LGECL_Submittal_LG181HSV3_201807 © LG Electronics Canada, Inc., North York, ON. All rights reserved. "LG Life's Good" is registered trademark of LG Corp./www.LGcomfort.ca

