

Job Name/Location:

Tag #:

Date:

For:  File  Resubmit

PO No.:

Approval  Other \_\_\_\_\_

Architect:

GC:

Engr:


Mech:

Rep:

(Company)

(Project Manager)

**ARNU073CEA2**  
**Multi V™ Floor Standing (with case)**  
**7,500 Btu/h Indoor Unit**

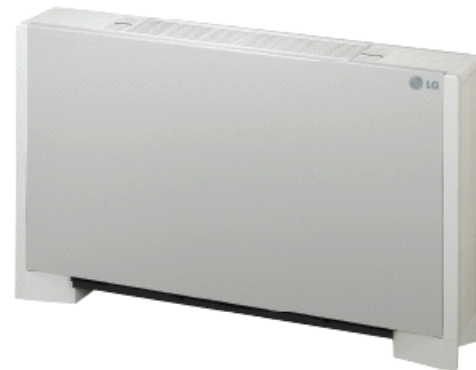

**Performance:**

Total Cooling Capacity <sup>1</sup> (Btu/h)	7,500
Heating Capacity (Btu/h)	8,500
Power Input <sup>2</sup> (W)	30

Cooling Nominal Test Conditions:  
 Indoor: 80°F DB/67°F WB  
 Outdoor: 95°F DB

Heating Nominal Test Conditions:  
 Indoor: 70°F DB  
 Outdoor: 47°F DB/43°F WB

**Electrical:**

Power Supply (V/Hz/∅)	208-230/60/1
Rated Amps (A)	0.1

**Piping:**

Refrigerant:

Liquid Line (in, OD)	1/4 Flare
Vapor Line (in, OD)	1/2 Flare

Condensate:

Gravity Condensate Drain (in, OD)	1/2
Factory Installed Pump	No

**Controls Features:**

- Auto changeover (Heat Recovery only)
- Auto operation
- Auto restart
- Child lock
- Dual thermistor control
- Group control
- E.S.P. control
- Hot start
- Self diagnostics
- Sleep mode
- Timer (on/off)
- Weekly schedule
- Soft dry (dehumidification)
- Fan speed control

**Optional Accessories:**

- Wireless Handheld Remote Controller<sup>3</sup> - PQWRHDF0
- LG Programmable Thermostat - PREMTB10U
- Simple Controller with Mode (Black) - PQRCVCL0Q
- Simple Controller with Mode (White) - PQRCVCL0QW
- Simple Controller without Mode (Black) - PQRCHCA0Q
- Simple Controller without Mode (White) - PQRCHCA0QW
- Dry Contact Unit (1 contact, 24 VAC external power) - PQDSB1
- Dry Contact with Economizer Interface- PQDSBC1
- Dry Contact for Third Party Thermostat - PQDSBNGCM1
- Wall Mounted Temperature Sensor - PQRSTA0

**Unit Data:**

Refrigerant Type	R410A
Refrigerant Control	EEV
Sound Pressure <sup>4</sup> dB(A) (H/M/L)	35/33/31
Filter Type	Washable
Filter Quantity	2
Filter Dimensions	13-3/8"x7-1/4"x3/4"
Net Unit Weight (lbs)	60
Shipping Weight (lbs)	69

**Fan:**

Type	Sirocco
Fan Quantity	3
Motor/Drive	Brushless Digitally Controlled/Direct
Motor Quantity	2
Airflow Rate H/M/L (CFM)	300/265/229

**Notes:**

1. See Engineering Manual for sensible and latent capacities.
2. The Power Input is rated at high speed.
3. Requires an LG Programmable Thermostat, Simple Controller with Mode or a Simple Controller without Mode.
4. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
5. All communication cable to be minimum 18 AWG, 2-conductor, stranded, shielded and must comply with applicable local and national code.
6. Power wiring cable size must comply with the applicable local and national code.
7. This unit comes with a dry nitrogen charge.
8. This data is rated 0 ft above sea level, with 25 ft of refrigerant line per indoor unit and a 0 ft level difference between outdoor and indoor units. All capacities are net with a combination ratio between 95 – 105%.
9. Must follow installation instructions in the applicable LG installation manual.



Job Name/Location:

**ARNU073CEA2**

Multi V™ Floor Standing (with case)




7,500 Btu/h Indoor Unit



Tag #:

Date:

PO No.:

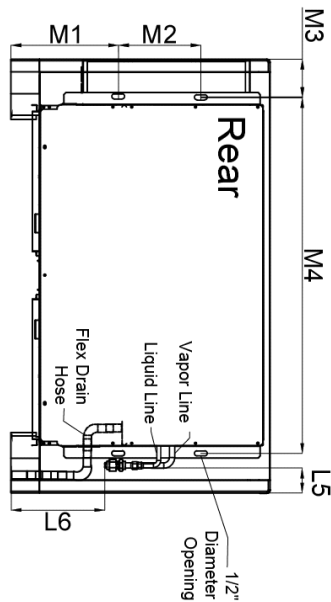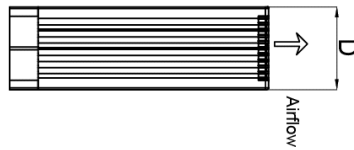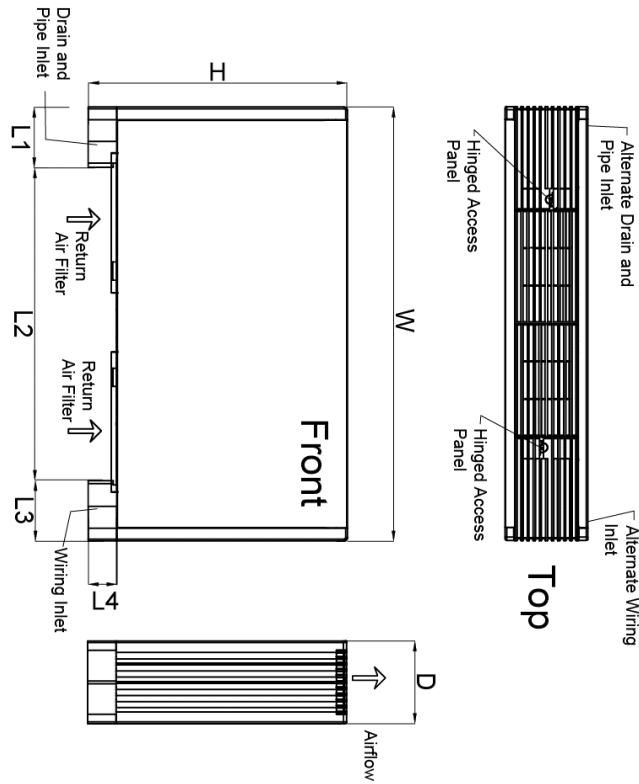

W	42-3/16"
H	25"
D	8"
L1	5-13/16"
L2	30-9/16"
L3	5-13/16"
L4	2-3/4"
L5	2-1/2"
L6	11"
M1	10-3/8"
M2	7-13/16"
M3	4-1/2"
M4	33-3/4"

Note - All dimensions have a tolerance of ±0.25 in.