

Job Name/Location:

Tag #:

Date: _____ For: File Resubmit
 PO No.: _____ Approval Other _____
 Architect: _____ GC: _____
 Engr: _____ Mech: _____
 Rep: _____
 (Company) (Project Manager)



ARWB290DA2 (a) ARWB192DA2
 Multi V™ Water II Heat Recovery (b) ARWB096DA2
 24.0 Ton Water Source Unit

Performance:

Cooling Mode:

Nominal Capacity (Btu/h)	286,600
Rated Capacity (Btu/h)	280,000
EER ¹ (Btu/W·h)	11.40
IEER ¹ (Btu/W·h)	18.10

Heating Mode:

Nominal Capacity (Btu/h)	322,500
Rated Capacity (Btu/h)	310,000
COP ¹ (W/W)	4.26

Nominal capacities are outside the scope of AHRI Standard 1230.
 Rated capacities are in accordance with AHRI Standard 1230-2010.

Electrical: (a) ARWB192DA2 (b) ARWB096DA2

Power Supply (V/Hz/Ø)	460/60/3	460/60/3
MOP (A)	35	20
MCA (A)	26.2	13.0
Rated Amps (A)	23.1	10.4
Compressor A (A)	10.4	10.4
Compressor B (A)	12.7	-
Max Starting Current (A)	92.8	-

Piping:

Refrigerant: (a) ARWB192DA2 (b) ARWB096DA2

Refrigerant Charge (lbs)	19.4	16.1
Liquid Line ² (in, OD)	1/2 Flare	3/8 Flare
Vapor Line High ² (in, OD)	7/8 Braze	3/4 Flare
Vapor Line Low ² (in, OD)	1-1/8 Braze	7/8 Braze

Water: (a) ARWB192DA2 (b) ARWB096DA2

Water Inlet/Outlet (in)	1-1/2 FPT	1-1/4 FPT
-------------------------	-----------	-----------

Condensate: (a) ARWB192DA2 (b) ARWB096DA2

Condensate Line (in)	3/4	3/4
----------------------	-----	-----

Standard Features:

- Limited Warranty with LG Certified Installation
 - Two Year Functional Parts Warranty
 - Additional Four Year Compressor Warranty
- Fault Detection and Diagnosis

Required Accessories:

- ARCNB21 (frame connector Y-branch)

Water Operating Range:

CLG Mode Entering Water Range (°F)	50-113
HTG Mode Entering Water Range (°F)	23-113
Synchronous (°F)	23-113

Unit Data:

Refrigerant Type	R410A
Refrigerant Control	EEV
Max Number of Indoor Units ³	49
Sound Pressure ⁴ dB(A)	53
Net Unit Weight (a) + (b) (lbs)	525 + 375
Shipping Weight (a) + (b) (lbs)	570 + 420
Communication Cable ⁵ (No. x AWG)	2 x 18
Heat Exchanger Type	Stainless Steel Plate
Heat Rejected to Equipment Room (Btu/h)	3,414
Total Heat of Rejection (Btu/h)	344,030

Compressor:

Inverter Scroll Quantity	2
Constant Scroll Quantity	1
Oil/Type	PVE/FVC68D

Condenser Water:

Flow Rate (a) + (b) (GPM)	50.8 + 25.4
Pressure Drop (a) + (b) (ft wg)	14.4 + 8.9

Notes:

- 1.EER, IEER, COP mentioned in the tables above is applied with non-ducted indoor units. Values are subject to change without notice. Performance data found on the AHRI website <http://www.ahridirectory.org/> supersedes the data found on this submittal.
- 2.For main pipe segment size, refer to the LATS Multi V tree diagram.
- 3.The combination ratio must be between 50-130%.
- 4.Sound pressure levels are tested in an anechoic chamber under ISO Standard 1996 and for the combination of water cooled units.
- 5.All communication cable to be minimum 18 AWG, 2-conductor, stranded, shielded and must comply with applicable local and national code.
- 6.The rated data mentioned in the above tables is applied with non-ducted indoor units.
- 7.Nominal data is rated 0 ft above sea level, with 25 ft of refrigerant line per indoor unit and a 0 ft level difference between outdoor and indoor units. All capacities are net with a combination ratio between 95 – 105%.
- 8.The voltage tolerance is ± 10%.
- 9.Power wiring cable size must comply with the applicable local and national code.



Job Name/Location:



ARWB290DA2 (a) ARWB192DA2
 Multi V™ Water II Heat Recovery (b) ARWB096DA2
 24.0 Ton Water Source Unit



Tag #: _____

Date: _____

PO No.: _____

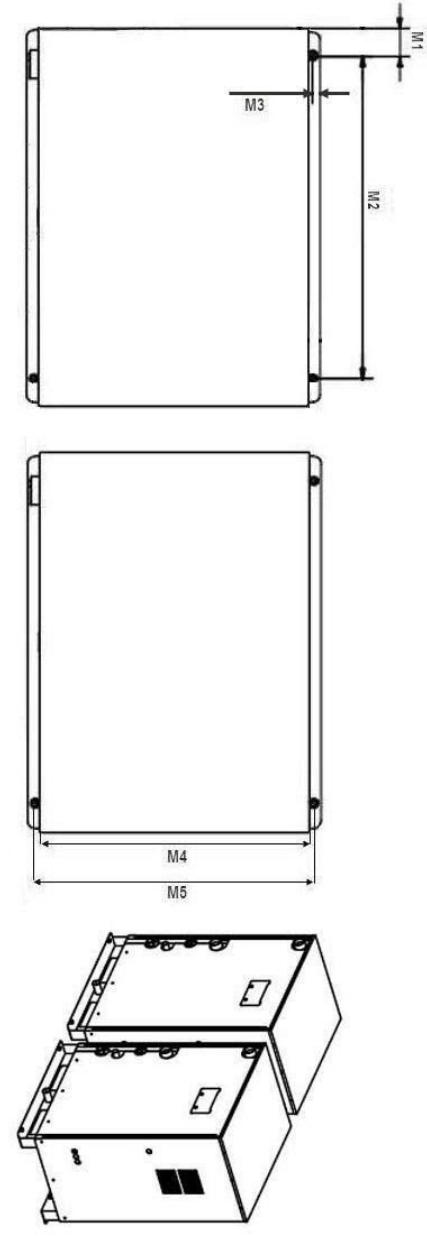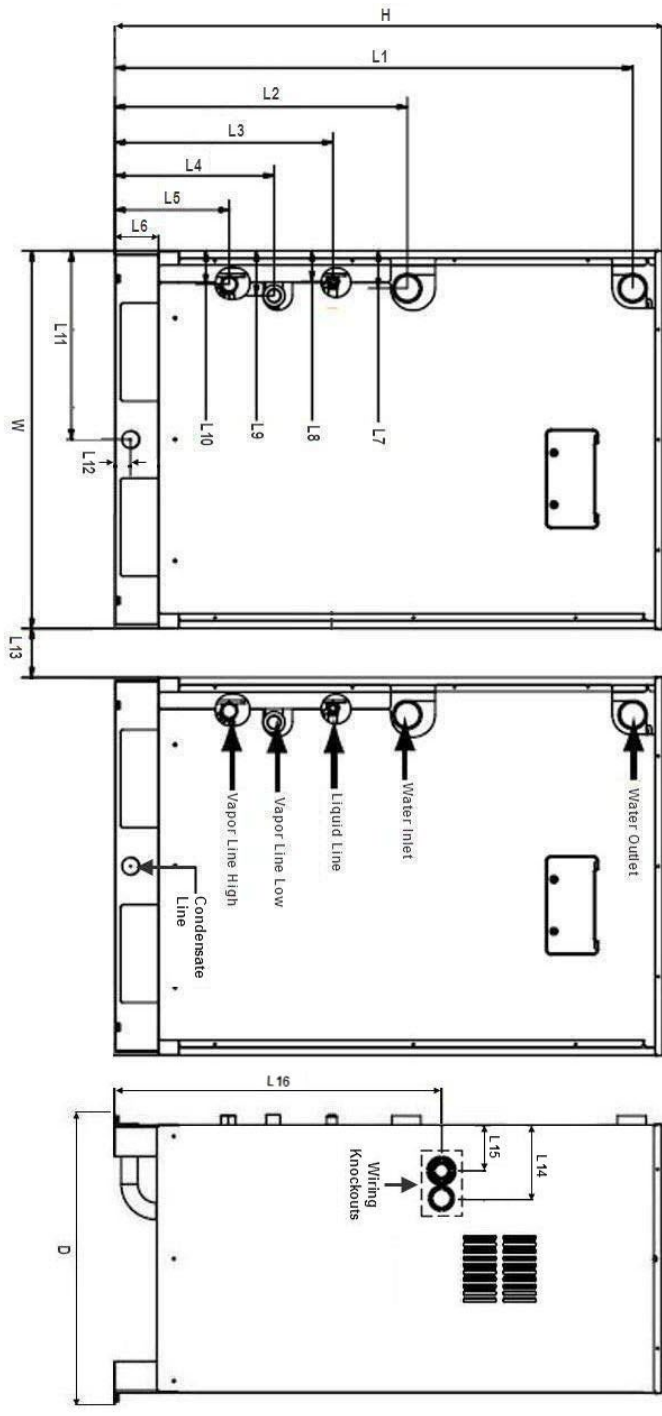

Note - All dimensions have a tolerance of ± 0.25 in.

W	30-13/32
H	44-3/32
D	23-19/32
L1	41-5/8
L2	23-1/2
L3	17-17/32
L4	12-13/16
L5	9-1/4
L6	3-21/32
L7	3-1/2
L8	2-15/32
L9	3-5/8
L10	2-3/4
L11	15-3/16
L12	1-1/4
L13	6
L14	5-5/8
L15	3-9/16
L16	26-27/32
M1	2-1/4
M2	25-29/32
M3	19/32
M4	21-17/32
M5	22-13/32