

Job Name/Location:

Tag #:

Date:

For:  File  Resubmit

PO No.:

Approval  Other \_\_\_\_\_

Architect:

GC:

Engr:

Mech:

Rep:

(Company)

(Project Manager)

**ARWB390DA2** (a) ARWB192DA2  
**Multi V™ Water II Heat Recovery** (b) ARWB192DA2  
**32.0 Ton Water Source Unit**



**Performance:**

**Cooling Mode:**

Nominal Capacity (Btu/h)	382,200
Rated Capacity (Btu/h)	N/A
EER <sup>1</sup> (Btu/W·h)	N/A
IEER <sup>1</sup> (Btu/W·h)	N/A

**Heating Mode:**

Nominal Capacity (Btu/h)	429,900
Rated Capacity (Btu/h)	N/A
COP <sup>1</sup> (W/W)	

Nominal capacities are outside the scope of AHRI Standard 1230.  
 Rated capacities are in accordance with AHRI Standard 1230-2010.

**Electrical:**

(a) ARWB192DA2 (b) ARWB192DA2

Power Supply (V/Hz/Ø)	460/60/3	460/60/3
MOP (A)	35	35
MCA (A)	26.2	26.2
Rated Amps (A)	23.1	23.1
Compressor A (A)	10.4	10.4
Compressor B (A)	12.7	12.7
Max Starting Current (A)	92.8	92.8

**Piping:**

Refrigerant: (a) ARWB192DA2 (b) ARWB192DA2

Refrigerant Charge (lbs)	19.4	19.4
Liquid Line <sup>2</sup> (in, OD)	1/2 Flare	1/2 Flare
Vapor Line High <sup>2</sup> (in, OD)	7/8 Braze	7/8 Braze
Vapor Line Low <sup>2</sup> (in, OD)	1-1/8 Braze	1-1/8 Braze

Water: (a) ARWB192DA2 (b) ARWB192DA2

Water Inlet/Outlet (in)	1-1/2 FPT	1-1/2 FPT
-------------------------	-----------	-----------

Condensate: (a) ARWB192DA2 (b) ARWB192DA2

Condensate Line (in)	3/4	3/4
----------------------	-----	-----

**Standard Features:**

- Limited Warranty with LG Certified Installation
  - Two Year Functional Parts Warranty
  - Additional Four Year Compressor Warranty
- Fault Detection and Diagnosis

**Required Accessories:**

- ARCNB21 (frame connector Y-branch)

**Water Operating Range:**

CLG Mode Entering Water Range (°F)	50-113
HTG Mode Entering Water Range (°F)	23-113
Synchronous (°F)	23-113

**Unit Data:**

Refrigerant Type	R410A
Refrigerant Control	EEV
Max Number of Indoor Units <sup>3</sup>	64
Sound Pressure <sup>4</sup> dB(A)	54
Net Unit Weight (a) + (b) (lbs)	525 + 525
Shipping Weight (a) + (b) (lbs)	570 + 570
Communication Cable <sup>5</sup> (No. x AWG)	2 x 18
Heat Exchanger Type	Stainless Steel Plate
Heat Rejected to Equipment Room (Btu/h)	3,414
Total Heat of Rejection (Btu/h)	458,707

**Compressor:**

Inverter Scroll Quantity	2
Constant Scroll Quantity	2
Oil/Type	PVE/FVC68D

**Condenser Water:**

Flow Rate (a) + (b) (GPM)	50.8 + 50.8
Pressure Drop (a) + (b) (ft wg)	14.4 + 14.4

**Notes:**

1. EER, IEER, COP mentioned in the tables above is applied with non-ducted indoor units. Values are subject to change without notice. Performance data found on the AHRI website <http://www.ahridirectory.org/> supersedes the data found on this submittal.
2. For main pipe segment size, refer to the LATS Multi V tree diagram.
3. The combination ratio must be between 50-130%.
4. Sound pressure levels are tested in an anechoic chamber under ISO Standard 1996 and for the combination of water cooled units.
5. All communication cable to be minimum 18 AWG, 2-conductor, stranded, shielded and must comply with applicable local and national code.
6. The rated data mentioned in the above tables is applied with non-ducted indoor units.
7. Nominal data is rated 0 ft above sea level, with 25 ft of refrigerant line per indoor unit and a 0 ft level difference between outdoor and indoor units. All capacities are net with a combination ratio between 95 – 105%.
8. The voltage tolerance is ± 10%.
9. Power wiring cable size must comply with the applicable local and national code.



Job Name/Location:



**ARWB390DA2** (a) ARWB192DA2  
 Multi V™ Water II Heat Recovery (b) ARWB192DA2  
 32.0 Ton Water Source Unit



Tag #: \_\_\_\_\_

Date: \_\_\_\_\_

PO No.: \_\_\_\_\_

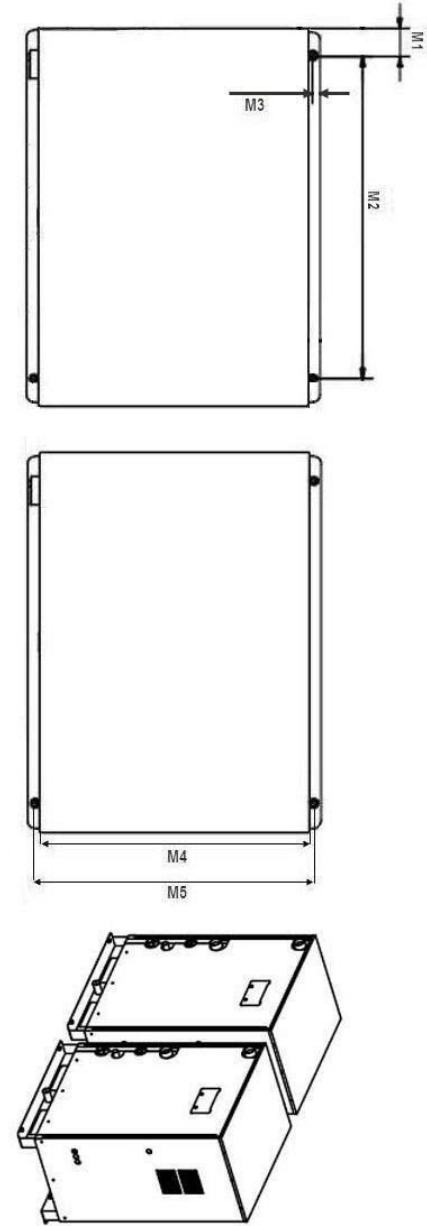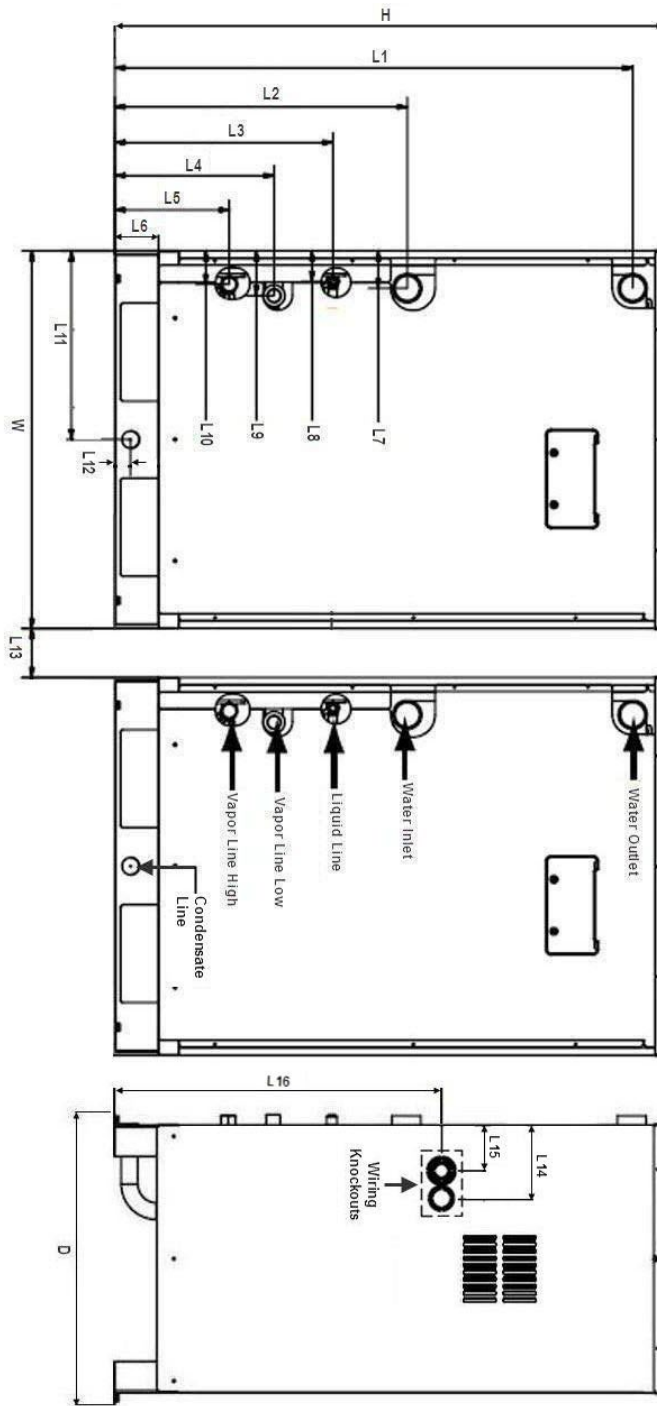

Note - All dimensions have a tolerance of ± 0.25 in.

W	30-13/32
H	44-3/32
D	23-19/32
L1	41-5/8
L2	23-1/2
L3	17-17/32
L4	12-13/16
L5	9-1/4
L6	3-21/32
L7	3-1/2
L8	2-15/32
L9	3-5/8
L10	2-3/4
L11	15-3/16
L12	1-1/4
L13	6
L14	5-5/8
L15	3-9/16
L16	26-27/32
M1	2-1/4
M2	25-29/32
M3	19/32
M4	21-17/32
M5	22-13/32