

Job Name/Location:

Tag #:

Date:

For: File Resubmit

PO No.:

Approval Other

Architect:

GC:

Engr:

Mech:

Rep:

(Company)

(Project Manager)

Header Kits

10 Port





Insulation Properties:

Material	Polyolefin Foam
UL94 Flame Classification	HF-1

Fitting Properties:

Material	Copper
Design Pressure	551 PSIG

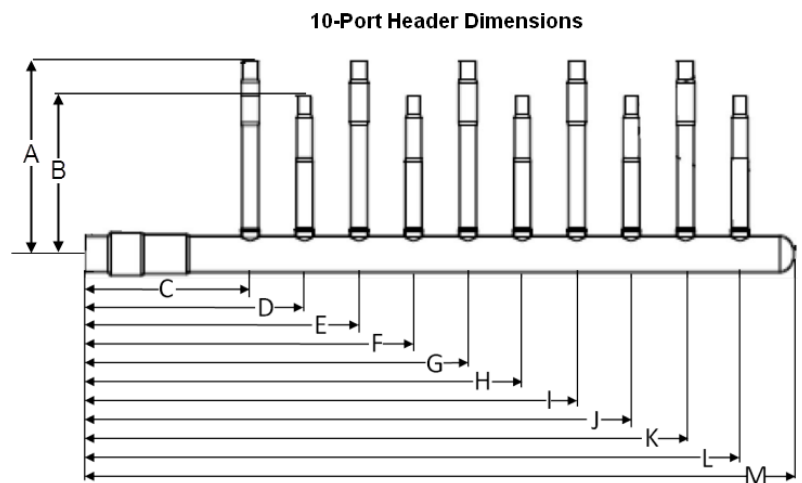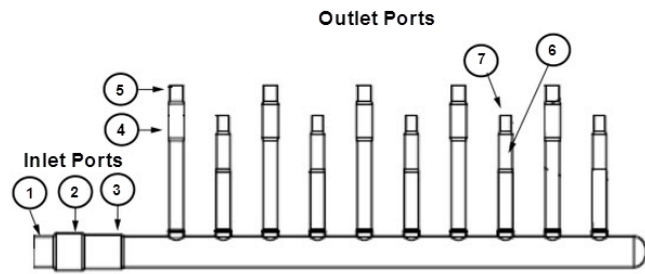

Not to scale



Insulation for Header		
Model	Qty	
	Liquid	Vapor
ARBL1010	1	1
ARBL2010	1	1



Tube End Caps			
Model	Qty		
	Ø1/4	Ø1/2	Ø5/8
ARBL1010	2	2	2
ARBL2010	2	2	2



Insulation for Tube End Caps	
Model	Qty
ARBL1010	6
ARBL2010	6

Header Connection Diameters (in)								
Model	Header Type	Port Identifier						
		1	2	3	4	5	6	7
ARBL1010	Liquid	-	3/8	1/2	3/8	1/4	3/8	1/4
	Vapor	7/8	1	1-1/8	3/4	5/8	5/8	1/2
ARBL2010	Liquid	-	3/4	5/8	3/8	1/4	3/8	1/4
	Vapor	1-1/8	1-3/8	1-1/4	3/4	5/8	5/8	1/2

Header Dimensions ¹ (in)														
Model		A	B	C	D	E	F	G	H	I	J	K	L	M
ARBL1010	Liquid	5-29/32	4-23/32	4-23/32	7-3/32	9-15/32	11-27/32	14-7/32	16-19/32	18-31/32	21-11/32	23-23/32	26-3/32	28-11/32
	Vapor	5-29/32	5-23/32	6-5/16	8-11/16	11-1/16	13-7/16	15-13/16	18-3/16	20-9/16	22-15/16	25-5/16	27-11/16	29-7/8
ARBL2010	Liquid	5-29/32	4-23/32	4-7/32	6-19/32	8-31/32	11-11/32	13-23/32	16-3/32	18-15/32	20-27/32	23-7/32	25-19/32	27-9/16
	Vapor	5-29/32	5-23/32	7-5/32	9-17/32	11-29/32	14-9/32	16-21/32	19-1/32	21-13/32	23-25/32	26-5/32	28-17/32	30-17/32

Notes:

- 1.LG header fittings must be used. Field supplied header fittings are not permitted.
- 2.Kit components must be kept dry and free of debris before installation.
- 3.Must follow installation instructions in the applicable LG installation manual.