

Job Name/Location:

Tag #:

Date:

For:  File  Resubmit

PO No.:

Approval  Other

Architect:

GC:

Engr:

Mech:

Rep:

(Company)

(Project Manager)

**ARUN360BT3**  
Multi V™ III Heat Pump  
30.0 Ton Outdoor Unit

(a) ARUN144BT3  
(b) ARUN144BT3  
(c) ARUN072BT3



**Performance:**

**Cooling Mode:**

Nominal Capacity (Btu/h)	360,000
Power Input <sup>1</sup> (kW)	25.42

**Heating Mode:**

Nominal Capacity (Btu/h)	405,000
Power Input <sup>1</sup> (kW)	26.06

Nominal Capacity is outside the scope of AHRI Standard 1230 and based on the following conditions:

Indoor: 80°F DB / 67°F WB

Indoor: 70°F DB

Outdoor: 95°F DB

Outdoor: 47°F DB / 43°F WB

**Electrical:** (a) ARUN144BT3 (b) ARUN144BT3 (c) ARUN072BT3

	(a) ARUN144BT3	(b) ARUN144BT3	(c) ARUN072BT3
Power Supply (V/Hz/Ø)	208-230/60/3	208-230/60/3	208-230/60/3
MOP (A)	70	70	35
MCA (A)	49.9	49.9	23.3
Rated Amps (A)	44.8	44.8	19.4
Compressor A (A)	18.3	18.3	15.4
Compressor B (A)	20.5	20.5	-
Fan (A)	6.0	6.0	4.0
Combined Max Starting Current (A)			191.1

**Piping:** (a) ARUN144BT3 (b) ARUN144BT3 (c) ARUN072BT3

	(a) ARUN144BT3	(b) ARUN144BT3	(c) ARUN072BT3
Refrigerant Charge (lbs)	20.7	20.7	12.1
Liquid Line <sup>2</sup> (in, OD)	1/2	1/2	3/8
Vapor Line <sup>2</sup> (in, OD)	1-1/8	1-1/8	3/4

**Standard Features:**

- Night Quiet Operation
- Fault Detection and Diagnosis

**Required Accessories:**

- Frame Connector Y-branch - ARCNN21
- Frame Connector Y-branch -ARCNN31

**Optional Accessories:**

- Hail Guard Kit (6 ton outdoor units) -ZHGDKA01A
- Hail Guard Kit (8-12 ton outdoor units) -ZHGDKA02A (2 required)
- Air Guide (6 ton outdoor units) - PRAGX2S0
- Air Guide (8-12 ton outdoor units) - PRAGX3S0 (4 required)

**Operating Range:**

Cooling (°F DB)	23 - 122
Heating (°F WB)	-4 - 60

**Unit Data:**

Refrigerant Type	R410A
Refrigerant Control	EEV
Max Number of Indoor Units <sup>3</sup>	58
Sound Pressure <sup>4</sup> dB(A)	62
Net Unit Weight (a) + (b) + (c) (lbs)	617 + 617 + 418
Shipping Weight (a) + (b) + (c) (lbs)	650 + 650 + 441
Communication Cable <sup>5</sup> (No x AWG)	2 x 18
Heat Exchanger Coating	GoldFin™

**Compressor:**

Inverter Scroll Quantity	3
Constant Scroll Quantity	2
Oil/Type	PVE/FVC68D

**Fan:**

Type	Propeller
Quantity (a) + (b) + (c)	2 + 2 + 1
Motor/Drive	Brushless Digitally Controlled/Direct
Air Flow Rate (a) + (b) + (c) (CFM)	23,900

**Notes:**

- For AHRI ratings, refer to the AHRI website <http://www.ahridirectory.org/>.
- For main pipe segment size, refer to the LATS Multi V tree diagram.
- The combination ratio must be between 50-130%.
- Sound Pressure levels are tested in an anechoic chamber under ISO Standard 1996 for the combination of outdoor units.
- All communication cable to be minimum 18 AWG, 2-conductor, stranded, shielded and must comply with applicable local and national code. Cables terminate at each frame.
- Nominal data is rated 0 ft above sea level, with 25 ft of refrigerant line per indoor unit and a 0 ft level difference between outdoor and indoor units. All capacities are net with a combination ratio between 95-105%.
- The voltage tolerance is ± 10%.
- Power wiring cable size must comply with the applicable local and national code. Cables terminate at each frame.
- AHRI 1230 Certification Program includes models up to 300MBh. Refer to AHRI certification directory for corresponding single frame units.



**ARUN360BT3**  
 Multi V™ III Heat Pump  
 30.0 Ton Outdoor Unit


- (a) ARUN144BT3
- (b) ARUN144BT3
- (c) ARUN072BT3



Tag #:

Date:

PO No.:

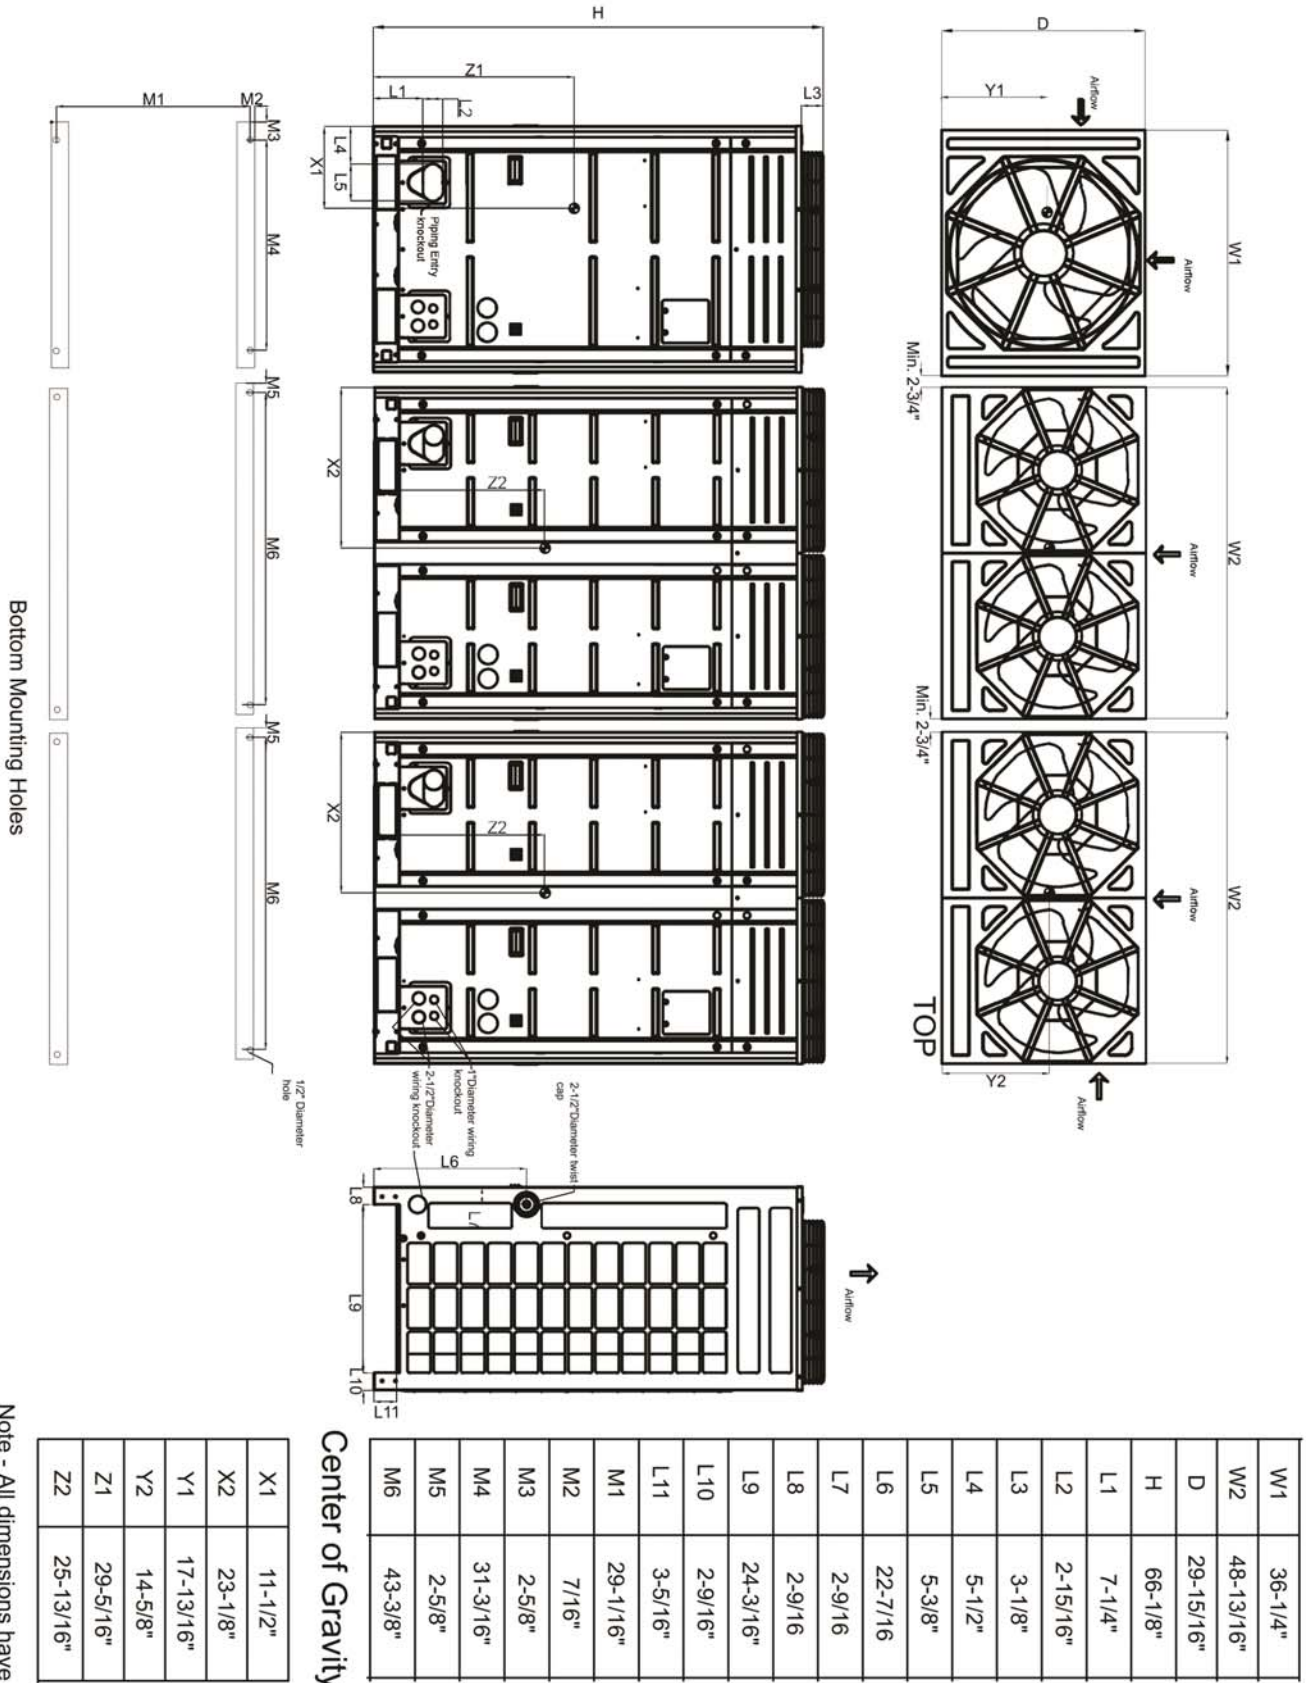

Bottom Mounting Holes

X1	11-1/2"
X2	23-1/8"
Y1	17-13/16"
Y2	14-5/8"
Z1	29-5/16"
Z2	25-13/16"

Center of Gravity

W1	36-1/4"
W2	48-13/16"
D	29-15/16"
H	66-1/8"
L1	7-1/4"
L2	2-15/16"
L3	3-1/8"
L4	5-1/2"
L5	5-3/8"
L6	22-7/16"
L7	2-9/16"
L8	2-9/16"
L9	24-3/16"
L10	2-9/16"
L11	3-5/16"
M1	29-1/16"
M2	7/16"
M3	2-5/8"
M4	31-3/16"
M5	2-5/8"
M6	43-3/8"

Note - All dimensions have a tolerance of ± 0.25 in.

