

Job Name/Location:			Tag #:			
Date:	For:	File	Resubmit			
PO No.:		Approval	Other			
Architect:	GC:					
Engr:	Mech:					
Rep: (Company)  LC248HV  Single Zone 3x3 Four-Way Ce Outdoor Unit (ODU) - LUU249HV, Inde	9		LIG Life's Good	BOYSTEEN CO.		
Performance:			<b>Operating Rang</b>	ge:		
Cooling:			Outdoor Unit:			
Cooling Capacity (Min~Rated~Max) (Btu/h)	9,600 ~ 24,000 ~ 28		Cooling (°F DB) Heating (°F WB)		5 ~ 118 -4 ~ +64	
SEER EER		20 12.6	Indoor Unit:			
	- Energy Efficiency Ratio	12.0	Cooling (°F WB) Heating (°F DB)		57 ~ 77 59 ~ 81	
Heating Capacity			System Data:			
(Min~Rated~Max) (Btu/h)	10,800 ~ 27,000 ~ 30	<b>I</b>	Refrigerant Type		R410A	
Max. Heating @ Indoor 70°F DB		10.5	Refrigerant Cont		EEV	
Outdoor 17°F DB		5,000	Refrigerant Char	ge (lbs.)	4.41	
Outdoor 5°F DB Outdoor -4°F DB		3,600	IDU Sound Press	. 112		
HSPF - Heating Seasonal Performance Factor		0,760	(H/M/L) (±1 dB[/	307	36 / 34	
Ü			(Cooling / Heati		48 / 52	
Electrical:					/ 143.3	
Power Supply (V¹/Hz/Ø)	208-230,		IDU Net / Shippir		2 / 57.3	
MOP (A) MCA (A)		30 20	1	ping Weight (lbs.)	14 / 21	
Cooling Rated Amps (A)		15.7	Heat Exchanger (	Coating G	oldFin™	
Heating Rated Amps (A)		15.7	Fan:			
Compressor (A)	0.4	13.5	ODU Type	P	ropeller	
Fan Motor (IDU + ODU) (A) Cooling Power Input (kW)	0.6	+ 1.6 1.9	IDU Type		oss Flow	
Heating Power Input (kW)		2.3	Fan Speeds (Fan/		4/5/4	
MOP - Maximum Overcurrent Protection MC	A - Minimum Circuit Ampacity		Quantity (ODU + Motor/Drive	FIDU)  Brushless Digitally Controlle	1+1	
Piping:			ODU Air Flow Ra		2,048	
Liquid (in., O.D.)		3/8	IDU Air Flow (CFI		30 / 459	
Vapor (in., O.D.) Additional Refrigerant (oz./ft.)		5/8 0.43	Dehumidification	n (pts./hr.)	4.5	
Min. / Max. Pipe Length (ft.) <sup>2</sup>	6.6	/ 164	Notes:			
Piping Length (no add'l refrig., ft.) Max. Elevation (ft.)		24.6	Acceptable operating vo     Piping lengths are equiva			
		98.4	<ol><li>Must comply with applic</li></ol>	icable codes for fire isolation dampers. re tested in an anechoic chamber under ISO Standard 3745.		
<ul> <li>Internal Condensate Pump</li> <li>Swirl Wind</li> <li>Ni</li> </ul>	uto Changeover tra-quiet Turbo Fan ght Quiet Operation otional Wi-Fi Control		All communication / cor and must be a minimum or grounded to the chassis of 6. This unit comes with a d 7. This data is rated 0 ft. ab outdoor and indoor units.     8. Power wiring cable size recommendations.	nnection (power) cable from the outdoor unit to the indoor unit is fiel of four-conductor, 14 AWG, stranded, shielded or unshielded (if shield f the outdoor unit only), and must comply with applicable local and na	ed, it must be ational codes.	
Included Accessories:				ademark of ASHRAE. LonWorks® is a trademark of Echelon Corporation		
Wireless Remote Controller - PQWRHQ0FDB	3					
	.CP 5 BACnet Gateway - PACP5 entilation Kit + Flange³ - PTVK		Heater Relay Kit- PRAR Remote Controller - PR			
MultiSITE™ CRC1 - PREMTBVC0   P   MultiSITE CRC1+ - PREMTBVC1   FI   MultiSITE Comm. Mgr PBACNBTR0A   A   PI-485 - PMNFP14A1   W   Dry Contact - PDRYCB300   B   LonWorks® Gateway - PLNWKB100   Lo	TVK420 lange - PTVK430	ation to -40°F)	Inverter	Unitary Small HP AHRI Standard 210/240 Certification applies only when the complete system is listed with AHRI.	EIED®	

## LC248HV

Single Zone 3x3 Four-Way Ceiling Cassette
Outdoor Unit (ODU) - LUU249HV. Indoor Unit (IDU) - LCN248HV



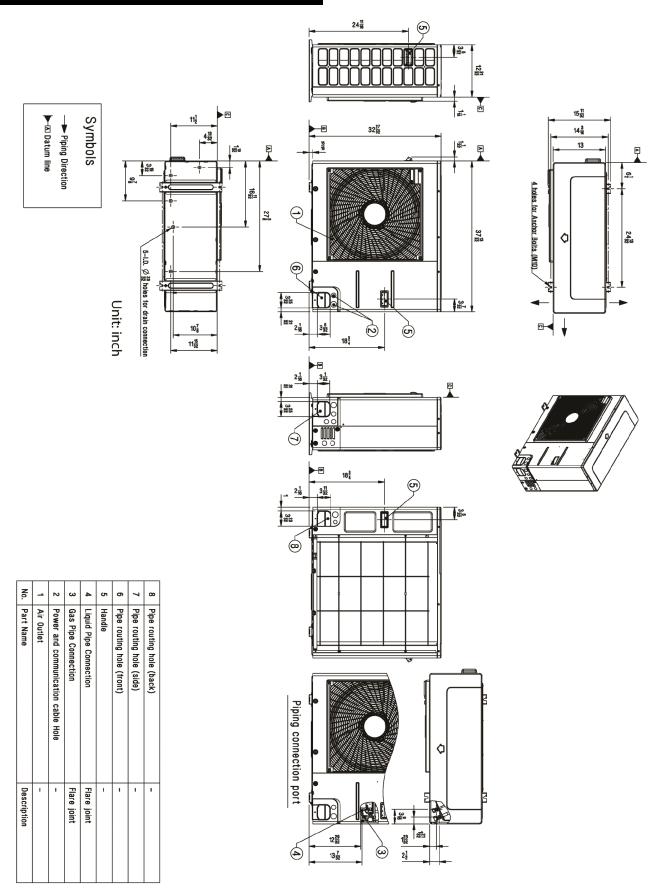

## LC248HV

Single Zone 3x3 Four-Way Ceiling Cassette
Outdoor Unit (ODU) - LUU249HV, Indoor Unit (IDU) - LCN248HV



Tag No.: \_\_\_\_\_\_

PO No.:

