

Date: \_\_\_\_\_ For:  File  Resubmit  
 PO No.: \_\_\_\_\_  Approval  Other \_\_\_\_\_  
 Architect: \_\_\_\_\_ GC: \_\_\_\_\_  
 Engr: \_\_\_\_\_ Mech: \_\_\_\_\_  
 Rep: \_\_\_\_\_  
 (Company) (Project Manager)



**ARUB121DTE4**  
 Multi V™ IV Heat Recovery  
 10.0 Ton Outdoor Unit

**Performance:**

**Cooling Mode:**

Nominal Capacity (Btu/h)	120,000
Power Input <sup>1</sup> (kW)	8.22

**Heating Mode:**

Nominal Capacity (Btu/h)	135,000
Power Input <sup>1</sup> (kW)	9.21

Nominal Capacity is outside the scope of AHRI Standard 1230 and based on the following conditions:

Indoor: 80°F DB / 67°F WB      Indoor: 70°F DB  
 Outdoor: 95°F DB      Outdoor: 47°F DB / 43°F WB

**Electrical:**

Power Supply (V/Hz/Ø)	460/60/3
MOP (A)	40
MCA (A)	24.0
Rated Amps (A)	19.7
Compressor A (A)	17.1
Compressor B (A)	-
Fan (A)	2.6

**Piping:**

Refrigerant Charge (lbs)	23.6
Liquid Line (in, OD)	1/2
Vapor Line High (in, OD)	3/4
Vapor Line Low (in, OD)	1-1/8

**Standard Features:**

- HiPOR (high pressure oil return)
- Smart Oil Control
- Split Coil Defrost
- Night Quiet Operation
- Fault Detection and Diagnosis

**Optional Accessories:**

- Air Guide (8-12 ton outdoor units) - PRAGX350 (2 required)
- Hail Guard Kit - ZHGDKA04A
- Low Ambient Baffle Kit - ZLABKA03A, Control Kit - PRVC2 (1 per system)

**\*\*(-9.9°F achieved only when all IDU's are operating in cooling mode. Does not impact synchronous operating range.)**

**Operating Range:**

Cooling (°F DB)**	14-122
Heating (°F WB)	-13 - 61
Synchronous	
Cooling Based (°F DB)	14 – 81
Heating Based (°F WB)	14 – 61

**Unit Data:**

Refrigerant Type	R410A
Refrigerant Control	EEV
Max Number of Indoor Units <sup>2</sup>	20
Sound Pressure <sup>3</sup> dB(A)	59.0
Net Unit Weight (lbs)	540
Shipping Weight (lbs)	573
Communication Cable <sup>4</sup> (No. x AWG)	2 x 18
Heat Exchanger Coating	GoldFin™

**Compressor:**

Compressor Type	HSS DC Scroll
Compressor Quantity	1
Oil/Type	PVE/FVC68D

**Fan:**

Type	Propeller
Quantity	2
Motor/Drive	Brushless Digitally Controlled/Direct
Air Flow Rate (CFM)	10,200

**Notes:**

- 1.For AHRI ratings, refer to the AHRI website <http://www.ahridirectory.org>.
- 2.The combination ratio must be between 50 – 130%.
- 3.Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
- 4.All communication cable to be minimum 18 AWG, 2-conductor, stranded, shielded and must comply with applicable local and national code.
- 5.Nominal data is rated 0 ft above sea level, with 25 ft of refrigerant line per indoor unit and a 0 ft level difference between outdoor and indoor units. All capacities are net with a combination ratio between 95-105%.
- 6.Power wiring cable size must comply with the applicable local and national code.
- 7.The voltage tolerance is 414-528V.



Job Name/Location:


**ARUB121DTE4**  
 Multi V™ IV Heat Recovery  
 10.0 Ton Outdoor Unit



Tag #:

Date:

PO No.:

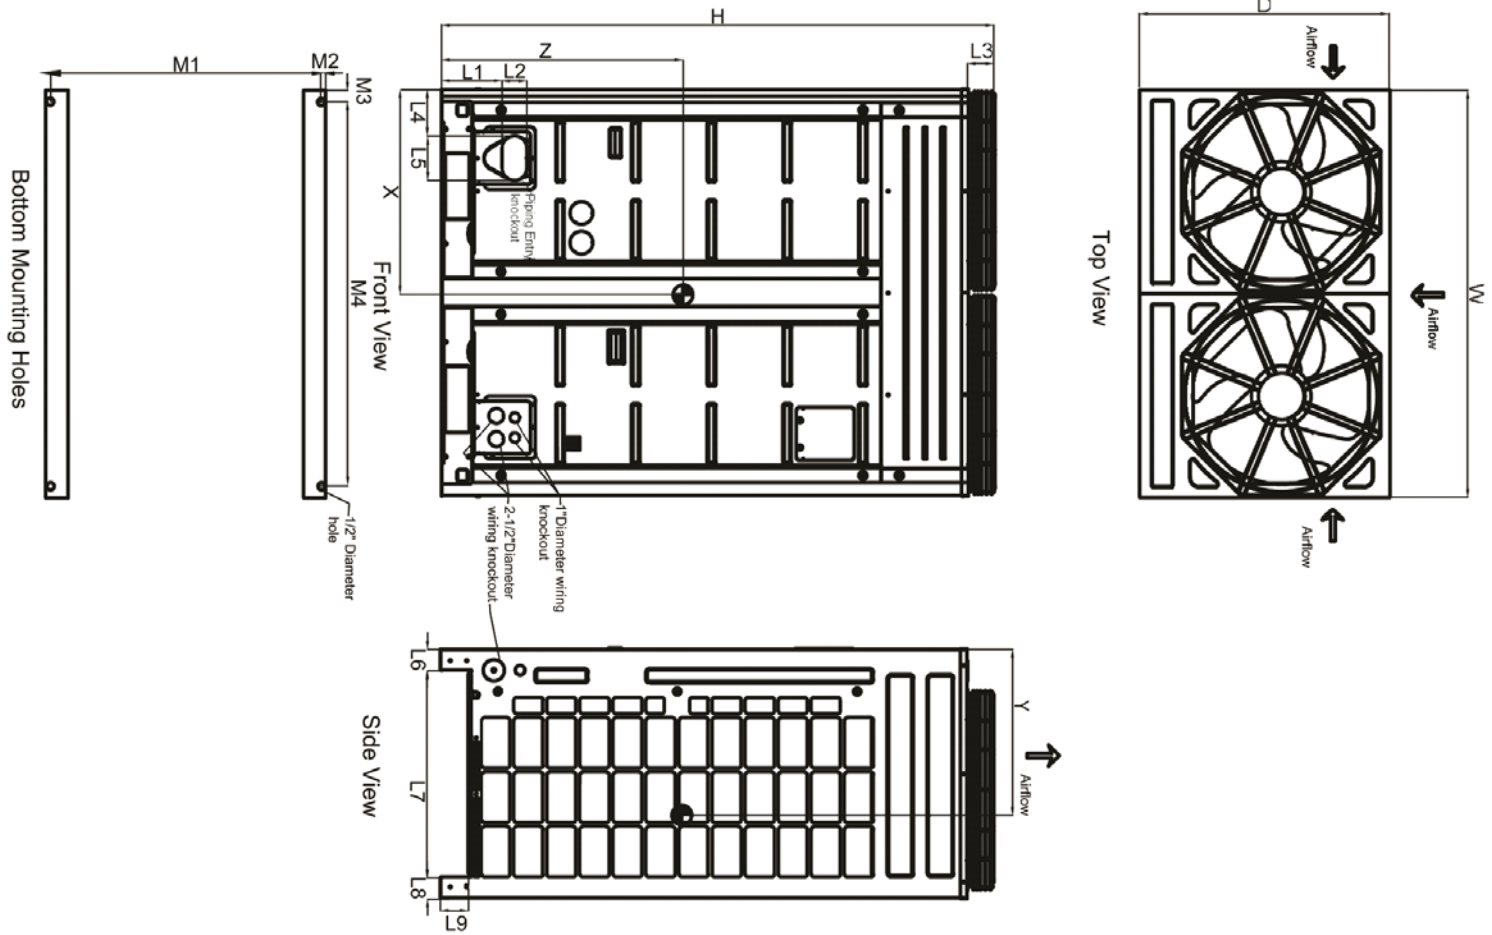

W	48-13/16"
D	29-15/16"
H	66-1/8"
L1	7-1/4"
L2	2-15/16"
L3	3-1/8"
L4	5-1/2"
L5	5-3/8"
L6	2-9/16"
L7	24-3/16"
L8	2-9/16"
L9	3-5/16"
M1	29-1/16"
M2	7/16"
M3	2-5/8"
M4	43-3/8"

**Center of Gravity**

X	17-5/8"
Y	13-1/2"
Z	29-5/8"

Note - All dimensions have a tolerance of ± 0.25 in.



= Center of Gravity