

Date: _____ For: File Resubmit
 PO No.: _____ Approval Other _____
 Architect: _____ GC: _____
 Engr: _____ Mech: _____
 Rep: _____
 (Company) (Project Manager)



ARUB360DTE4 (a) ARUB096DTE4
 Multi V™ IV Heat Recovery (b) ARUB121DTE4
 30.0 Ton Outdoor Unit (c) ARUB144DTE4



Performance:

Cooling Mode:

Nominal Capacity (Btu/h)	360,000
Power Input ¹ (kW)	23.23

Heating Mode:

Nominal Capacity (Btu/h)	405,000
Power Input ¹ (kW)	26.82

Nominal Capacity is outside the scope of AHRI Standard 1230 and based on the following conditions:
 Indoor: 80°F DB / 67°F WB Indoor: 70°F DB
 Outdoor: 95°F DB Outdoor: 47°F DB / 43°F WB

Electrical: (a) ARUB096DTE4 (b) ARUB121DTE4 (c) ARUB144DTE4⁹

Power Supply (V/Hz/Ø)	460/60/3	460/60/3	460/60/3
MOP (A)	35	40	40
MCA (A)	23.2	24.0	31.6
Rated Amps (A)	19.1	19.7	28.4
Compressor A (A)	16.5	17.1	12.9
Compressor B (A)	-	-	12.9
Fan (A)	2.6	2.6	2.6

Piping: (a) ARUB096DTE4 (b) ARUB121DTE4 (c) ARUB144DTE4

Refrigerant Charge (lbs)	23.6	23.6	23.6
Liquid Line ² (in, OD)	3/8	1/2	1/2
Vapor Line High ² (in, OD)	3/4	3/4	7/8
Vapor Line Low ² (in, OD)	7/8	1-1/8	1-1/8

Standard Features:

- HiPOR (high pressure oil return)
- Smart Oil Control
- Split Frame Defrost
- Night Quiet Operation
- Fault Detection and Diagnosis

Required Accessories:

- ARCNB21 (frame connector Y-branch)
- ARCNB31 (frame connector Y-branch)

Optional Accessories:

- Air Guide (8-12 ton outdoor units) - PRAGX3S0 (6 required)
- Hail Guard Kit - ZHGDKA04A (3 required)
- Low Ambient Baffle Kit - ZLABKA03A (3 required), Control Kit - PRVC2 (1 per system)

****(-9.9°F achieved only when all IDU's are operating in cooling mode. Does not impact synchronous operating range.)**

Operating Range:

Cooling (°F DB)**	14-122
Heating (°F WB)	-13 - 61
Synchronous	
Cooling Based (°F DB)	14 – 81
Heating Based (°F WB)	14 – 61

Unit Data:

Refrigerant Type	R410A
Refrigerant Control	EEV
Max Number of Indoor Units ³	58
Sound Pressure ⁴ dB(A)	63.9
Net Unit Weight (a) + (b) + (c) (lbs)	540 + 540 + 628
Shipping Weight (a) + (b) + (c) (lbs)	573 + 573 + 661
Communication Cable ⁵ (No x AWG)	2 x 18
Heat Exchanger Coating	GoldFin™

Compressor:

Compressor Type	HSS DC Scroll
Compressor Quantity	4
Oil/Type	PVE/FVC68D

Fan:

Type	Propeller
Quantity (a) + (b) + (c)	6
Motor/Drive	Brushless Digitally Controlled/Direct
Air Flow Rate (a) + (b) + (c) (CFM)	29,900

Notes:

- 1.For AHRI ratings, refer to the AHRI website <http://www.ahridirectory.org>.
- 2.For main pipe segment size, refer to the LATS Multi V tree diagram.
- 3.The combination ratio must be between 50-130%.
- 4.Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745 for the combination of outdoor units.
- 5.All communication cable to be minimum 18 AWG, 2-conductor, stranded, shielded and must comply with applicable local and national code. Cables terminate at each frame.
- 6.Nominal data is rated 0 ft above sea level, with 25 ft of refrigerant line per indoor unit and a 0 ft level difference between outdoor and indoor units. All capacities are net with a combination ratio between 95-105%.
- 7.Power wiring cable size must comply with the applicable local and national code. Cables terminate at each frame.
- 8.The voltage tolerance is 414-528V.9.The order of each of these units on the submittal (i.e., A+B+C) do not represent the installation order. Highest capacity unit is used as the Master, followed by the next smaller size as Slave 1 and so on.




Job Name/Location:

ARUB360DTE4 (a) ARUB096DTE4
 Multi V™ IV Heat Recovery (b) ARUB121DTE4
 30.0 Ton Outdoor Unit (c) ARUB144DTE4



Tag #: _____
 Date: _____
 PO No.: _____

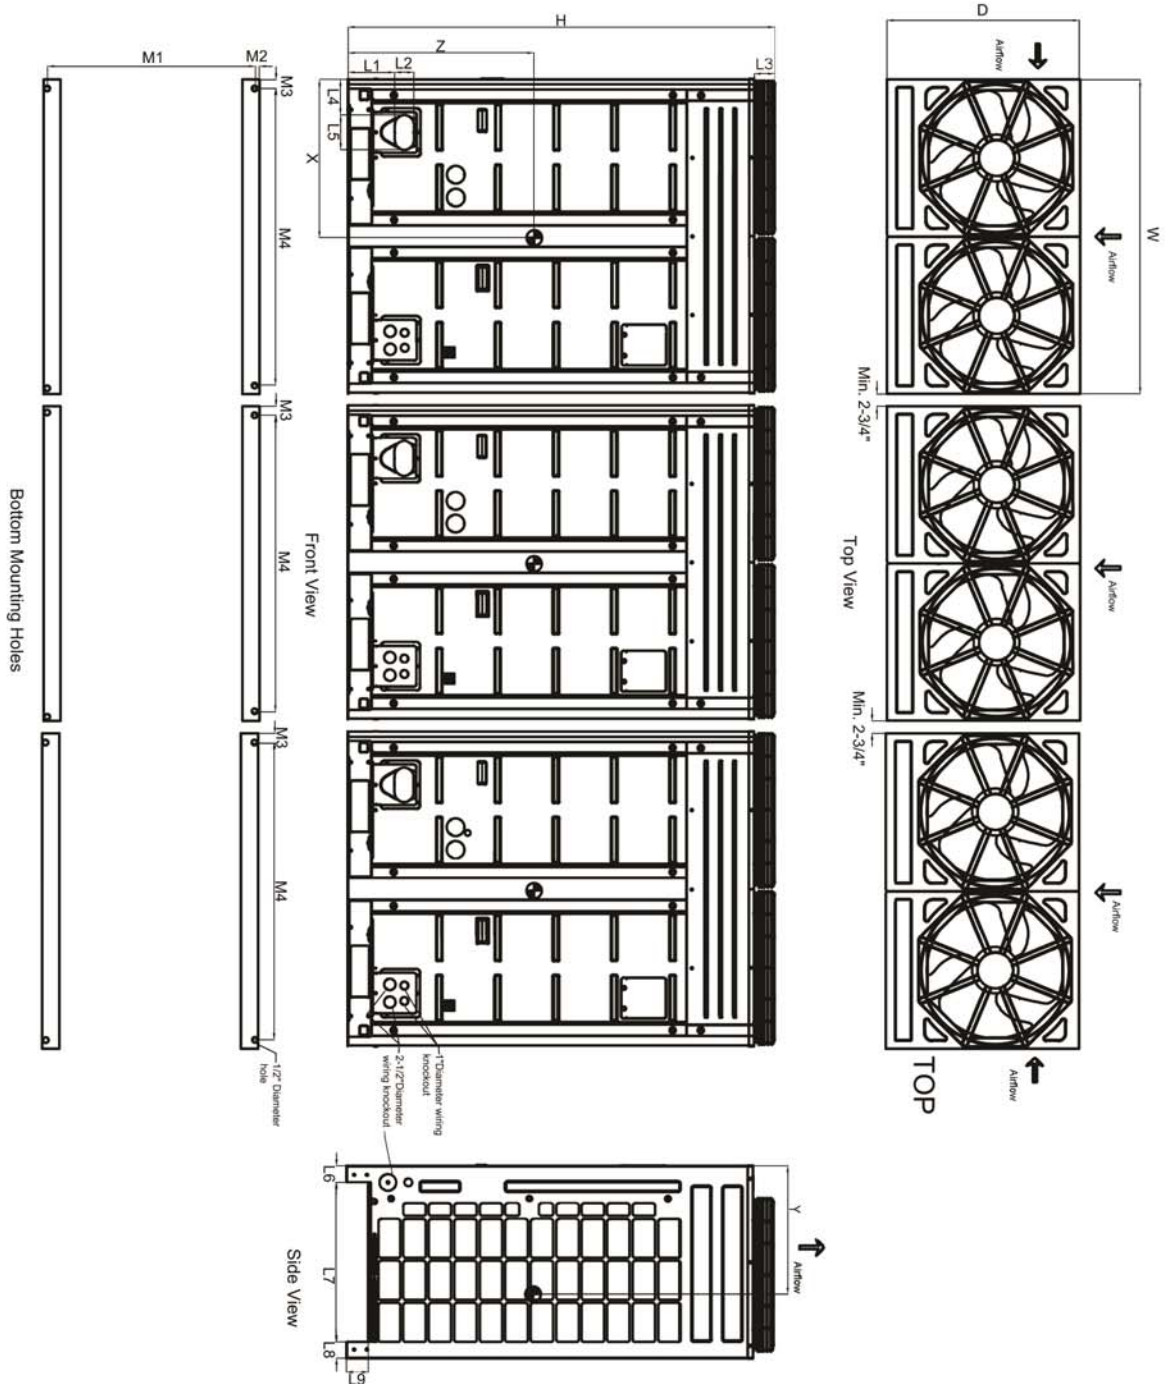

W	48-13/16"
D	29-15/16"
H	66-1/8"
L1	7-1/4"
L2	2-15/16"
L3	3-1/8"
L4	5-1/2"
L5	5-3/8"
L6	2-9/16"
L7	24-3/16"
L8	2-9/16"
L9	3-5/16"
M1	29-1/16"
M2	7/16"
M3	2-5/8"
M4	43-3/8"

Center of Gravity

X	24-3/4"
Y	21-9/16"
Z	29-7/8"

Note - All dimensions have a tolerance of ± 0.25 in.
 = Center of Gravity