

Job Name/Location:

Tag #:

Date:


| | | |
|------|----------|------------|
| For: | File | Resubmit |
| | Approval | Other_____ |

PO No.:

Architect: _____ GC: _____

Engr: _____ Mech: _____

Rep: _____
(Company) (Project Manager)



LH368HV4

Single Zone High Static Ducted

Outdoor Unit (ODU) - LUU369HV, Indoor Unit (IDU) - LHN368HV

Performance:

Cooling:

| | |
|--------------------------------|--------------------------|
| Cooling (Min~Rated~Max, Btu/h) | 14,400 ~ 36,000 ~ 41,400 |
| SEER | 19.0 |
| EER | 12.1 |

SEER - Seasonal Energy Efficiency Ratio EER - Energy Efficiency Ratio

Heating:

| | |
|--------------------------------|--------------------------|
| Heating (Min~Rated~Max, Btu/h) | 16,000 ~ 40,000 ~ 42,200 |
| HSPF | 9.7 |

HSPF - Heating Seasonal Performance Factor

Cooling Nominal Test Conditions:

Indoor: 80°F DB / 67°F WB
Outdoor: 95°F DB / 75°F WB

Heating Nominal Test Conditions:

Indoor: 70°F DB / 60°F WB
Outdoor: 47°F DB / 43°F WB

Electrical:

| | |
|------------------------------------|--------------|
| Power Supply ¹ (V/Hz/Ø) | 208-230/60/1 |
|------------------------------------|--------------|

Outdoor Unit:

| | |
|---------------------------|--------------------|
| MOP (A) | 40 |
| MCA (A) | 32 |
| Cooling Rated Amps (A) | 27.5 |
| Heating Rated Amps (A) | 27.5 |
| Compressor(A) | 22 |
| Fan Motor (IDU + ODU) (A) | 2.3 + (2x1.6) |
| Cooling Power Input (kW) | 0.72 ~ 2.98 ~ 4.00 |
| Heating Power Input (kW) | 0.77 ~ 3.08 ~ 3.50 |

MOP - Maximum Overcurrent Protection

MCA - Minimum Circuit Ampacity

Piping:

| | |
|---------------------------------------|------|
| Liquid Line (in., O.D.) | 3/8 |
| Vapor Line (in., O.D.) | 5/8 |
| Additional Refrigerant (oz./ft.) | 0.43 |
| Max. Pipe Length ² (ft.) | 246 |
| Piping Length (no add'l refrig., ft.) | 24.6 |
| Max. Elevation (ft.) | 98.4 |

Features:

- ESP control
- Hot start
- Internal Condensate Pump
- Inverter (variable speed fan)
- Auto restart
- Control lock
- Group control
- Timer (on/off)
- Sleep Mode
- Optional Wi-Fi Control
- Aux Heater relay kit

Optional Accessories:

- MultiSITE™ CRC1 - PREMTBVC0
- MultiSITE CRC1+ - PREMTBVC1
- MultiSITE Comm. Mgr. - PBACNBTR0A
- AC Smart 5 - PACS5A000
- Simple Controller - PREMTC00U
- Wi-Fi module with cable - PWFMD200
- ACP 5 - PACP5A000
- Low Ambient Kit (Cooling operation to -40°C) PAG-HS4/PAG-HS5/PQCA0
- Dynamic V8 2VL Low Profile Air Cleaner - ZPLMV201A
- Base Pan Heater - PQSH1200
- Dry Contact (Simple) - PDRYCB300
- Dry Contact (3rd Party) - PDRYCB300
- Dry Contact (Setback) - PDRYCB400
- PI-485 - PMNFP14A1
- High Efficiency Filter Box - ZFBXM201A
- RS3 Remote Controller- PREMTB100
- Aux Heater Relay Kit- PRARH1

Operating Range:

Outdoor Unit:

| | |
|-----------------|----------|
| Cooling (°F DB) | 5 to 118 |
| Heating (°F WB) | -4 to 64 |

Indoor Unit:

| | |
|-----------------|----------|
| Cooling (°F WB) | 57 to 77 |
| Heating (°F DB) | 59 to 81 |

System Data:

| | |
|--|---------------|
| Refrigerant Type | R410A |
| Refrigerant Control | EEV |
| Refrigerant Charge (lbs.) | 7.5 |
| ODU Sound Pressure Max (Cool / Heat) ±3 dB(A) ³ | 52 / 54 |
| IDU Sound Pressure (H/M/L) ±3 dB(A) ³ | 44 / 42 / 40 |
| ODU Net / Shipping Weight (lbs.) | 198.9 / 223.1 |
| IDU Net / Shipping Weight (lbs.) | 85.3 / 99.4 |
| Heat Exchanger Coating | GoldFin™ |

Fan:

| | |
|--|---------------------------------------|
| ODU Type | Propeller |
| IDU Type | Sirocco |
| Fan Speeds (Fan/Cool/Heat) | 3 / 3 / 3 |
| Fan Quantity (ODU + IDU) | 2 + 2 |
| Motor/Drive | Brushless Digitally Controlled/Direct |
| ODU Air Circulation (CFM) | 3,884 |
| IDU Air Circulation (H/M/L) (CFM) | 1,130 / 989 / 848 |
| Default ESP (in wg) | 0.24 |
| Minimum ESP/Fan Setting Value ⁴ | 0.16 / 92 |
| Maximum ESP/Fan Setting Value ⁴ | 0.59 / 144 |
| Dehumidification Rate (pts/hr) | 5.9 |

Notes:

1. Acceptable operating voltage: 187V-253V.
2. Piping lengths are equivalent.
3. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
4. Maximum static pressure may result in reduced airflow (CFM).
5. All communication / connection (power) cable from the outdoor unit to the indoor unit is field supplied and is to be minimum four-conductor, 14 AWG, stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only), and must comply with applicable local and national codes.
6. See Engineering Manual for sensible and latent capacities.
7. Power wiring cable size must comply with the applicable local and national code.
8. The indoor unit comes with a dry helium charge.
9. This data is rated 0 ft. above sea level, with 24.6 ft. of refrigerant line and a 0 ft. level difference between outdoor and indoor units.
10. Must follow installation instructions in the applicable LG installation manual.



LH368HV4

Single Zone High Static Ducted


Outdoor Unit (ODU) - LUU369HV, Indoor Unit (IDU) - LHN368HV



Tag No.: _____

Date: _____

PO No.: _____

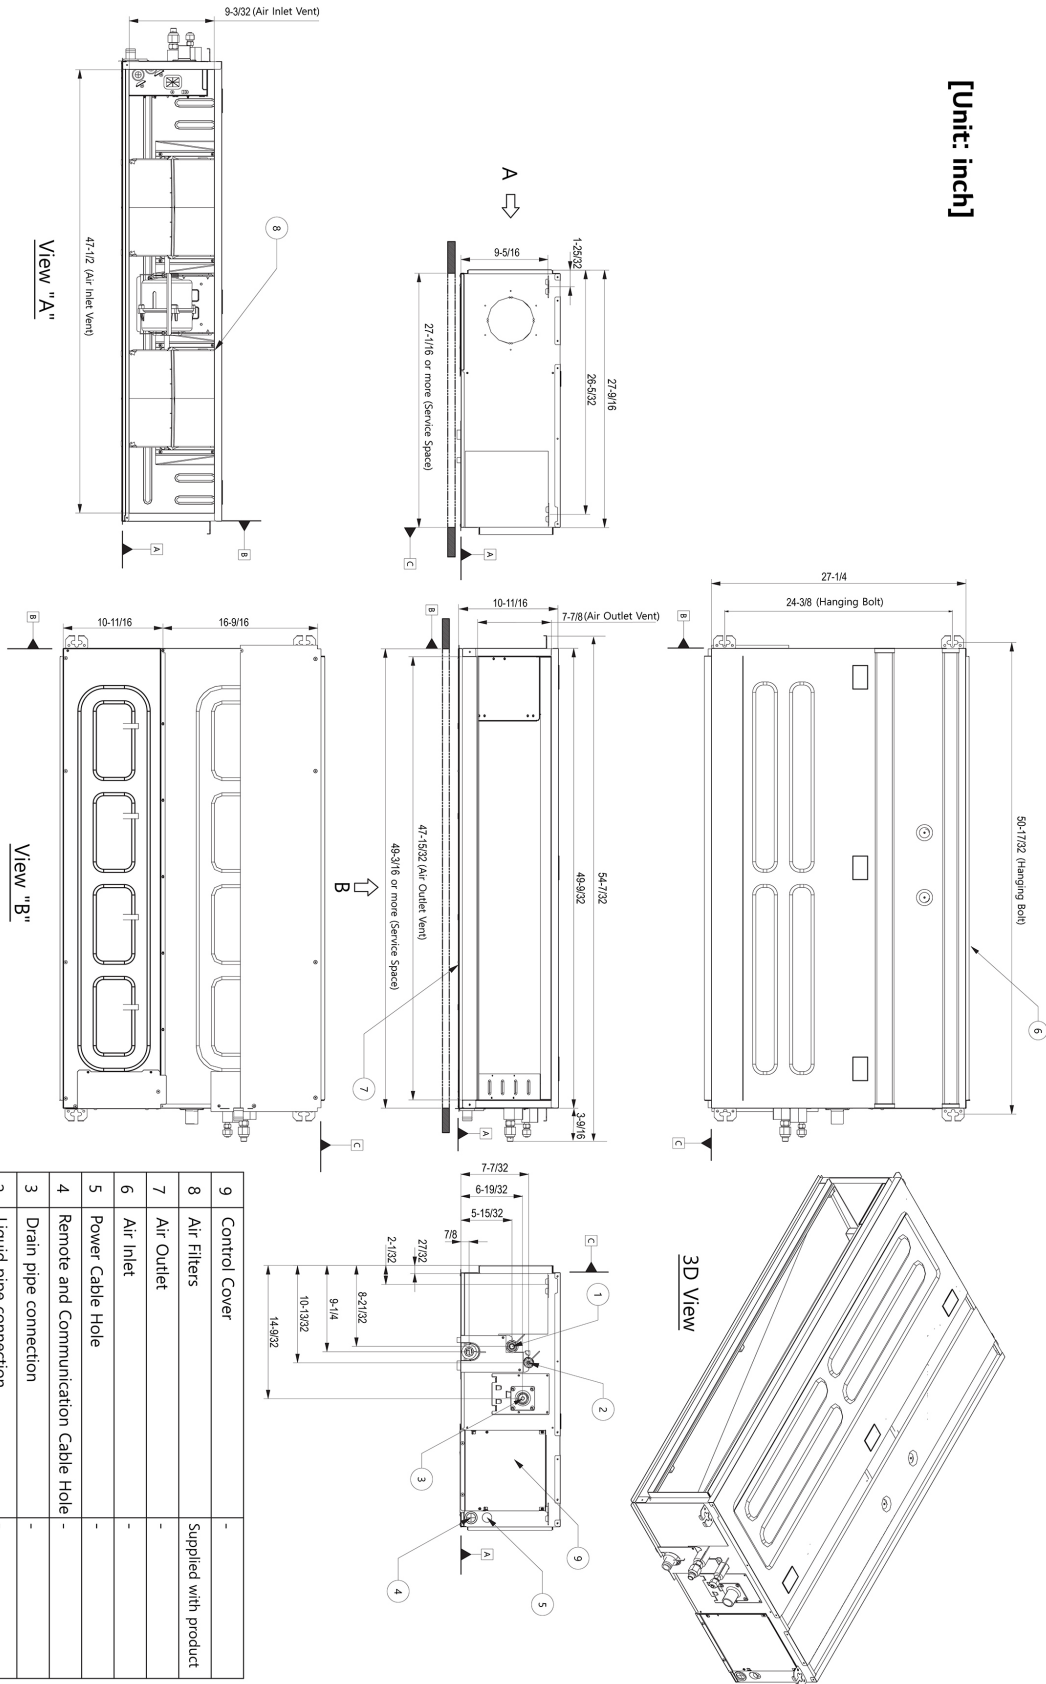

[Unit: inch]

| No. | Part Name | Description |
|-----|-------------------------------------|-----------------------|
| 9 | Control Cover | - |
| 8 | Air Filters | Supplied with product |
| 7 | Air Outlet | - |
| 6 | Air Inlet | - |
| 5 | Power Cable Hole | - |
| 4 | Remote and Communication Cable Hole | - |
| 3 | Drain pipe connection | - |
| 2 | Liquid pipe connection | - |
| 1 | Gas pipe connection | - |