

Date: \_\_\_\_\_ For:  File  Resubmit  
 PO No.: \_\_\_\_\_  Approval  Other \_\_\_\_\_  
 Architect: \_\_\_\_\_ GC: \_\_\_\_\_  
 Engr: \_\_\_\_\_ Mech: \_\_\_\_\_  
 Rep: \_\_\_\_\_  
 (Company) (Project Manager)



**ARWB576DAS4** (a) ARWB192DAS4  
 Multi V™ Water IV Heat Recovery (b) ARWB192DAS4  
 48.0 Ton Water Source Unit (c) ARWB192DAS4

**Performance:**

**Cooling Mode:**

Nominal Capacity (Btu/h)	576,000
--------------------------	---------

**Heating Mode:**

Nominal Capacity (Btu/h)	648,000
--------------------------	---------

Nominal capacities are outside the scope of AHRI Standard 1230 and based on the following conditions -

Cooling Nominal Test Conditions:	Heating Nominal Test Conditions:
Indoor: 80°F DB / 67°F WB	Indoor: 68°F DB
Water Inlet Temp: 86°F	Water Inlet Temp: 68°F

**Electrical:**

	(a) ARWB192DAS4	(b) ARWB192DAS4	(c) ARWB192DAS4
Power Supply (V/Hz/Ø)	460/60/3	460/60/3	460/60/3
MOP (A)	35	35	35
MCA (A)	28.0	28.0	28.0
Rated Amps (A)	22.4	22.4	22.4
Recommended Fuse Amps (A):	35	35	35

**Piping:**

Refrigerant:	(a) ARWB192DAS4	(b) ARWB192DAS4	(c) ARWB192DAS4
Refrigerant Charge (lbs)	6.6	6.6	6.6
Liquid Line <sup>1</sup> (in, OD)	1/2	1/2	1/2
Vapor Line High <sup>1</sup> (in, OD)	3/4	3/4	3/4
Vapor Line Low <sup>1</sup> (in, OD)	1-1/8	1-1/8	1-1/8

Water:	(a) ARWB192DAS4	(b) ARWB192DAS4	(c) ARWB192DAS4
Water Inlet/Outlet (in)	1-1/2	1-1/2	1-1/2

Condensate:	(a) ARWB192DAS4	(b) ARWB192DAS4	(c) ARWB192DAS4
Condensate Line (in)	3/4	3/4	3/4

**Standard Features:**

- Fault Detection and Diagnosis
- HiPDR (High Pressure Oil Return)
- Smart Oil Control

**Required Accessories:**

- ARCNB21 (frame connector Y-branch)
- ARCNB31 (frame connector Y-branch)

**Optional Accessories:**

- Variable Water Flow Valve Control Kit - PWFCN000

**Water Operating Range<sup>1</sup>:**

CLG Mode Entering Water Range (°F)	23-113
HTG Mode Entering Water Range (°F) <sup>2</sup>	14-113

**Synchronous Operating Range<sup>1</sup>:**

Entering Water Range (°F)	23-113
---------------------------	--------

**Unit Data:**

Refrigerant Type	R410A
Refrigerant Control	EEV
Max Number of Indoor Units <sup>3</sup>	64
Sound Pressure <sup>4</sup> (CLG/HTG) dB(A)	60/62
Net Unit Weight (a) + (b) + (c)	309 + 309 + 309
Shipping Weight (a) + (b) + (c)	331 + 331 + 331
Communication Cable <sup>5</sup> (No. x AWG)	2 x 18
Heat Exchanger Type	Stainless Steel Plate
Heat Rejected to Equip Rm (Btu/h)	7,863

**Compressor:**

Type	Hermetic Scroll
Drive	Inverter
Quantity	3
Oil/Type	PVE/FVC68D

**Condenser Water:**

Flow Rate (a) + (b) + (c) (GPM)	50.7 + 50.7 + 50.7
Pressure Drop (a) + (b) + (c) (ft wg)	9.7 + 9.7 + 9.7

**Notes:**

1. When entering water temperature is lower than 59°F, variable water flow control kit PWFCN000 is required.
2. When entering water temperature is lower than 23°F, water solution must be minimum 45% antifreeze.
3. The combination ratio must be between 50-130%.
4. Sound pressure levels are tested in an anechoic chamber under ISO Standard 3745.
5. All communication cable to be minimum 18 AWG, 2-conductor, stranded, shielded and must comply with applicable local and national code.
6. For AHRI ratings, refer to the AHRI website <http://www.ahridirectory.org>.
7. Nominal data is rated 0 ft above sea level, with 25 ft of refrigerant line per indoor unit and a 0 ft level difference between outdoor and indoor units. All capacities are net with a combination ratio between 95 – 105%.
8. Power wiring cable size must comply with the applicable local and national code.
9. The voltage tolerance is 414-528V.



Job Name/Location:

**ARWB576DAS4**

Multi V™ Water IV Heat Recovery  
48.0 Ton Water Source Unit

(a) ARWB192DAS4

(b) ARWB192DAS4


(c) ARWB192DAS4



Tag #:

Date:

PO No.:

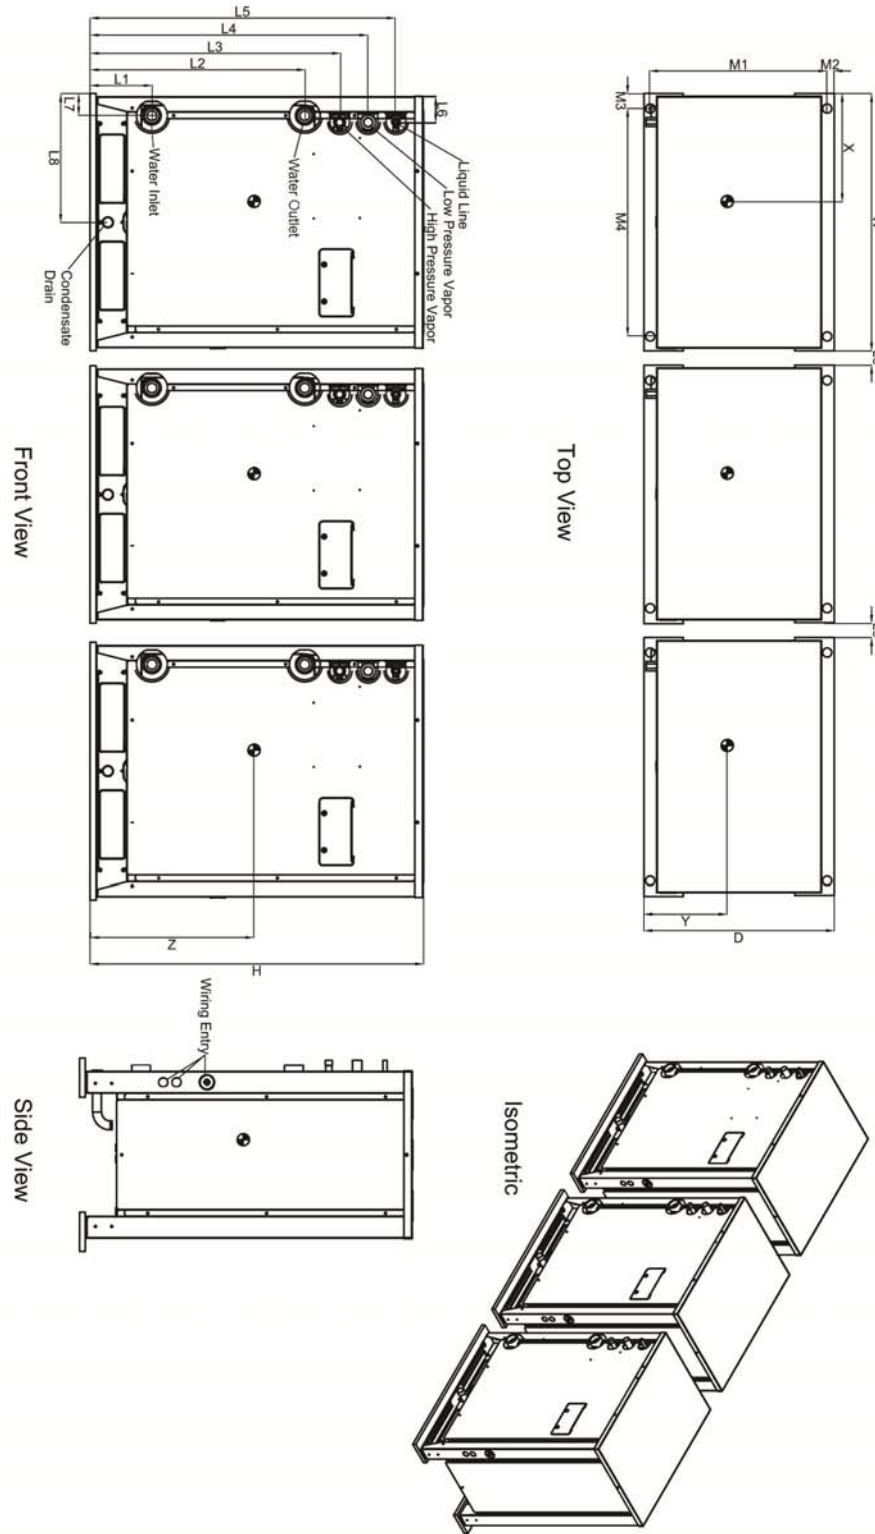

X	13-1/2"
Y	9-13/16"
Z	16-1/2"
W	29-3/4"
D	19-3/4"
H	39-1/4"
L1	6-5/8"
L2	25"
L3	29-1/4"
L4	32-1/2"
L5	35-15/16"
L6	3-1/8"
L7	2-1/4"
L8	14-3/4"
L9	4"
M1	18-1/4"
M2	3/4"
M3	2-7/16"
M4	24-13/16"