
Job Name/Location:	Tag #:			
Date:	For: File	Resubmit		
PO No.:	Approval	Other	€ LG	
Architect: GC:				
Engr: Mech	:			
Rep:	anager)		. LG	
LV241HV4 Single Zone Vertical Air Handler Unit Outdoor Unit (ODU) - LUU249HV Indoor Unit (IDU) - LVN	1241HV4	LG Life's Good	LG	
Performance:		Operating Range	e:	
Cooling:		Outdoor Unit:		
Cooling (Min~Rated~Max, Btu/h) 9,600 ~ 24,0 SEER2 / EER2	000 ~ 30,000 17.6/11.45	Cooling (°F DB) Heating (°F WB)	5 to 1 -4 to	
SEER - Seasonal Energy Efficiency Ratio EER - Energy Efficiency Ratio	17.6/11.45	Indoor Unit:	-4 tO	04
Heating: Heating (Min~Rated~Max, Btu/h) 10.800 ~ 27.0	200 20 000	Cooling (°F WB)	57 to	
Heating (Min~Rated~Max, Btu/h) 10,800 ~ 27,0	9.70	Heating (°F DB)	59 to	81
Max heating @ Indoor 70° DB (Btu/h)		System Data:		
Outdoor 17°F WB Outdoor 5°F WB*	26,000 21,400	Refrigerant Type/0		
Outdoor -4°F WB	20,760	Refrigerant Charge		
USDE Heating Seasonal Performance Factor			ure Max (Cool / Heat) $\pm 1 \text{ dB(A)}^3$ 48/5 re (H/M/L) $\pm 1 \text{ dB(A)}^3$ 36 / 34 / 3	
HSPF - Heating Seasonal Performance Factor * The Capacities at 5°F does not refer to H42 testing conditions. Cooling Nominal Test Conditions: Heating Nominal Test Conditions:				30
Indoor: 80°F DB / 67°F WB	s.	ODU Net Weight (ODU Shipping Wei	,	
Electrical:		IDU Net Weight (I		
Power Supply ¹ (V/Hz/Ø) 208	-230 / 60 / 1	IDU Shipping Weig	·	
Outdoor Unit:		Fan:		
MOP (A) MCA (A)	30 20	ODU /IDU Fan Typ	pe Propeller/Siroco	00
Cooling Rated Amps (A)	16.2	Fan Speeds (Fan/0	·	
Compressor(A) Fan Motor (IDU + ODU) (A)	13.5 1.1 + 1.6	Fan Quantity (OD	•	
]	2.00 ~3.26 2.25 ~ 3.04	Motor/Drive	Electronically Commutated Motor / Direction	ct
Heating Power Input (kW) 0.65 ~ MOP - Maximum Overcurrent Protection MCA - Minimum Circuit Ampaci		Maximum ODU A	ir Volume (CFM) 2,04	18
Piping:	0.40	IDU Air Volume D	efault (H/M/L) (CFM) 710 / 640 / 48	0
Liquid Line (in., O.D.) Vapor Line (in., O.D.)	3/8 5/8	ESP Operating Rai	nge (in-wg) 0.1 - 0.	.7
Additional Refrigerant (oz./ft.)	0.43	Minimum IDU Air	Flow Volume (CFM) 43	2
Max. Pipe Length ² (ft.)	6.6/164	Maximum IDU Air	Flow Volume (CFM) 78	;1
Piping Length (no add'l refrig., ft.) Max. Elevation (ft.)	24.6 98.4	Dehumidification	Rate (pts/hr) 4.	.0
Features:	70.4	Notes:		
Hot start Group control FCM (Flee	ed Motor) fan instant airflow of permitted ial Static	 All power/communics conductor, stranded, shi national code. If shielde Power wiring cable sise. The indoor unit come This data is rated 0 ft. difference between out 	uivalent. is are tested in an anechoic chamber under ISO Standard 3745. ation cable to be minimum 14 American wire gage (AWG), 4- leided or unshielded wire and must comply with applicable local a d, the wire must be grounded to the chassis at the outdoor unit oi ze must comply with the applicable local and national code. is above sea level, with 25 ft. of refrigerant line and a 0 ft. level	
□ Progrmmable Remote Controller - PREMTB100 □ Delux Remote Controller - PREMTB200 □ Dry Contact 3rd Party Thermostat - PDRYCB320 □ Electric Heater9 □ Remote Temperature Sensor - ZRTBS01 □ Downflow Conversion Kit - PNDFJ0 □ Aux Heater relay kit - PRARH1	-HS7 Wind Guards ng to 0°F	10. Controller not includ	CERTIFIED® www.ahridirectory.org	






Job Name/Location:

LUU249HV Single Zone Vertical Air Handler Unit




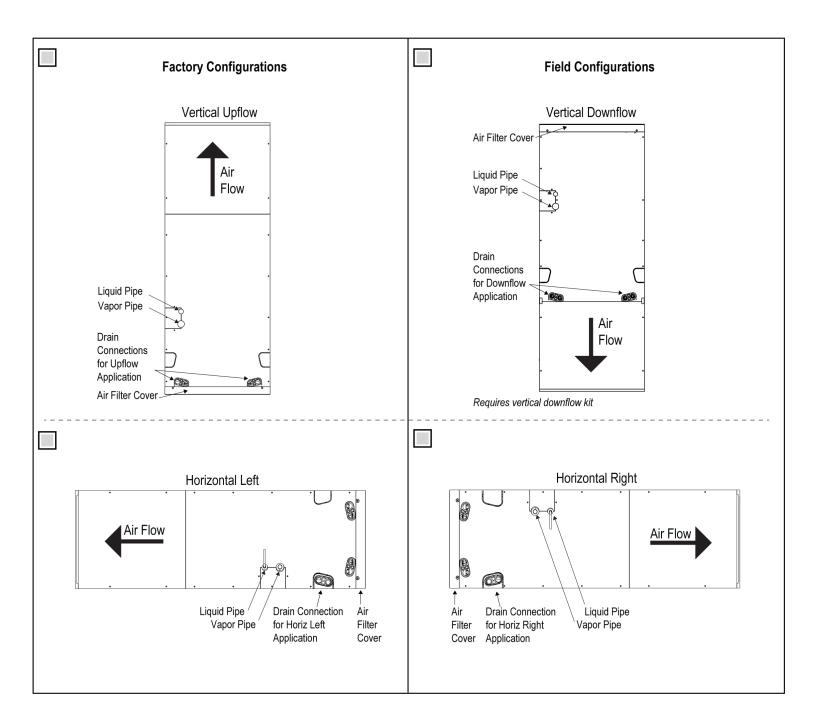


Job Name/Location:

LUU249HV

Single Zone Vertical Air Handler Unit




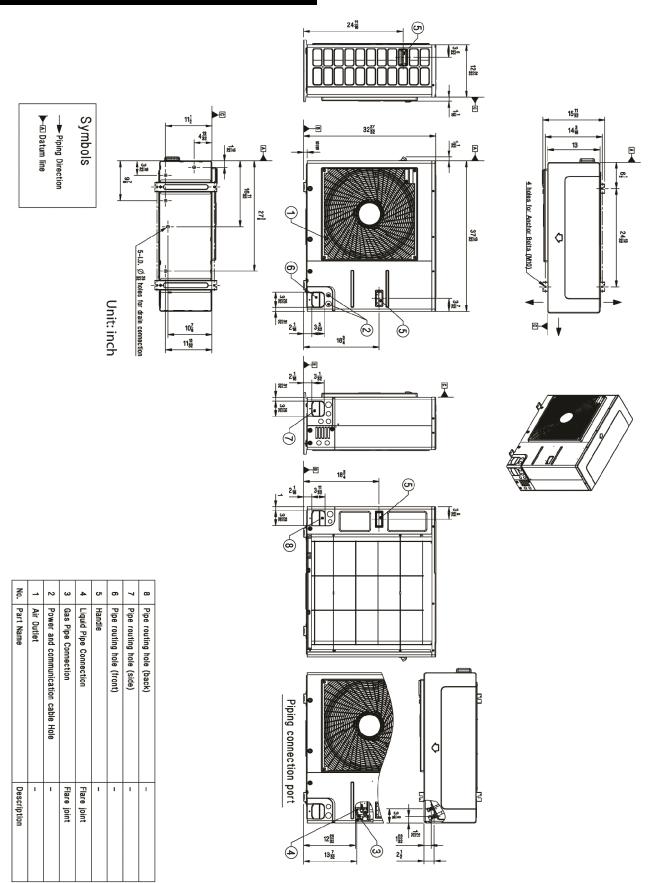



Job Name/Location:


LVN241HV4


Single Zone Vertical Air Handler Unit





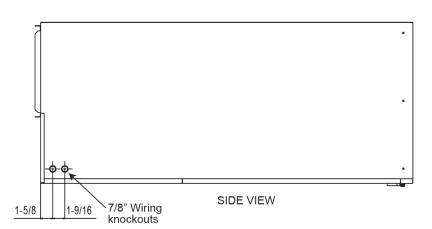

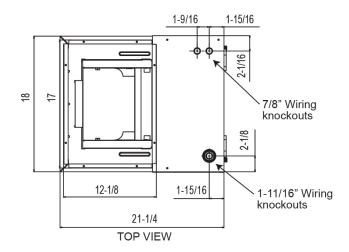



Unit: inches
Note: All measurements
have a tolerance of ±1/4 in.

