Job Name/Location: Tag No:

For: File Resubmit Date: Approval Other PO No.:

GC: **Architect:**

Mech: Engr:

Rep:

(Project Manager)

LMU30CHV

Multi F Inverter Heat Pump Outdoor Unit

Performance:

Cooling Capacity (MinRated-Max., Btu/h)	8,400~30,000~36,000
Heating Capacity (MinRated-Max., Btu/h)	10,080~32,000~38,400
Max. Heating Capacity at 17°F (Btu/h)	27,200
Max. Heating Capacity at 5°F (Btu/h)*	24,000
Max. Heating Capacity at -4°F (Btu/h)	20,400
Cooling COP @95°F (Rated)	3.8
Heating COP @47°F (Rated)	4.0
SEER 2 (Ducted / Non-Ducted)	18.5 / 22.0
EER 2 (Ducted / Non-Ducted)	12.0 / 13.0
HSPF 2 (Non-Ducted)	9.2 / 7.1
HSPF 2 (Ducted)	8.8 / 7.0

HSPF - Heating SeasonPerformace Factor
*The capacities at 5°F does not refer to H42 testing conditions

Heating Nominal Test Conditions: Cooling Nominal Test Conditions: Indoor: 80°F DB / 67°F WB Outdoor: 95°F DB / 75°F WB Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB

Electrical:

Power Supply (V/Hz/Ø) ¹	208-230V, 60 ₂ ‡
MOP (A)	20
MCA (A)	18,4
Recommended Fuse Size (A)	23
Cooling Rated Amps (A)	15.03
Heating Rated Amps (A)	15.03
Compressor (A)	0.73
Fan Motor (A)	19.0
Locked Rotor Amps (A)	17.0

MOP - Maximum Overcurrent Protection Piping:

Refrigerant Charge (lbs.) 6.17 Liquid Line Connection (in., O.D.) 1/4 x 4 Vapor Line Connection (in., O.D.) 3/8 x 4 Maximum Total Piping² (ft.) 246.1 Min. / Max. ODU to IDU Piping (ft.) 9.8 / 82.0 98.4 Piping Length (no add'l refrigerant, ft.) Maximum Elevation between ODU and IDU (ft.) 49.2 24.6 Maximum Elevation between IDU and IDU (ft.) IDU = Indoor Unit

ODU = Outdoor Unit Features:

- Auto operation
- Auto restart • Inverter (variable speed
- compressor) · Defrost / Deicing
- Restart delay (three [3] minutes)
- Self diagnosis
- Soft start
- Low ambient cooling down to 14°F

MCA - Minimum Circuit Ampacity

Optional Accessories:

- ☐ PI-485 PMNFP14A1
- ☐ AC Smart 5 PACS5A000
- ☐ Drain Pan Heater PQSH1200
- ☐ Low Ambient Kit -40°F cooling PQCA0, PAG-HS6 / PAG-HS7 Wind Baffle.
- ☐ Without PQCA0 cooling to 0°F





Operating Range:

Cooling (°F DB)	14 to 118
Heating (°F WB)	-4 to +64

Unit Data:

Refrigerant Type	R410A
Refrigerant Control	EEV
Sound Pressure (Cool / Heat) ±1 dB(A) ³	51 / 54
Net / Shipping Weight (lbs.)	138.9 / 154.3
Heat Exchanger Coating	Gold Fin™
Minimum No. of Indoor Units	2
Maximum No. of Indoor Units	4

Compressor:

-	Туре	Twin Rotary
(Quantity	1
(Oil / Type	FVC68D

Fan:

Туре	Propeller
Quantity	1
Motor / Drive	Brushless Digitally Controlled/Direct
Max. Airflow Rate (CFM)	2.119

Notes:

- 1. Acceptable operating voltage: 187V 253V.
- 2. Piping lengths are equivalent.
- 3. Sound pressure levels are tested in an anechoic chamber under ISO Standard
- 4. All power / communication cable to be minimum 14 AWG, 4-conductor, stranded, shielded or unshielded wire, and must comply with applicable local and national codes. If shielded, the wire must be grounded to the chassis at the outdoor unit only.
- 5. Power wiring size must comply with the applicable local and national codes.
- 6. This data is rated 0 ft. above sea level, with 0 ft. level difference between outdoor and indoor units, and the following refrigerant pipe lengths:

LMU180HV: 16.4 ft. x 2 = 32.8 ft. LMU240HV: 16.4 ft. x 3 = 49.2 ft.

LMU30CHV: 16.4 ft. x 4 = 65.6 ft.

LMU36CHV: 16.4 ft. x 4 = 65.6 ft.

All capacities are net with a combination ratio between 95 - 105%.

- 7. Must follow installation instructions in the applicable LG installation manual.
- 8. Refer to the Combintion Data Manual for combination capacity tables.
- 9. See the Performance Data Manual for sensible and latent capacities.












LMU30CHV Multi F Inverter Heat Pump Outdoor Unit



f	26	(1-1/32) "VT		, г ∨т	28(1–1/8)
397(16-21/32)	330(13)		•		
387(Q		
*				ΓυΊ	35(6-1/2)

[Unit : mm(inch)]
Gravity point

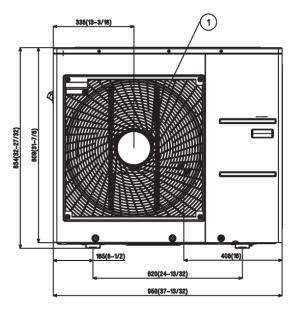

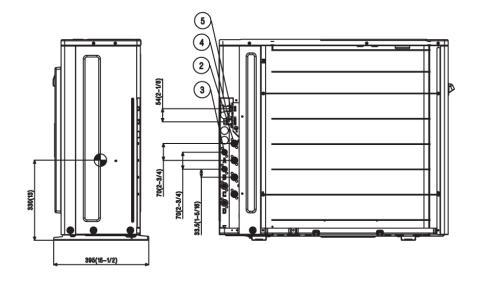

No.	Part Name	
1	Air discharge grille	
2	Vapor pipe connection	
3	Liquid pipe connection	
4	Main service valve (Liquid)	
5	Main service valve (Vapor)	

Notes:

- 1. Unit must be installed in compliance with the installation manual.
- 2. Unit must be grounded in accordance with the local or state regulations and applicable national codes.
- 3. All field-supplied electrical components and materials must comply with local, state, and national codes.
- 4. Electrical characteristics must be considered for electrical work and design. The capacity of power cable and circuit breaker for the outdoor unit must follow local, state, national, and manufacturer requirements.