Job I	Name/	Location	:
-------	-------	----------	---

n	Э	t۵	•
ν	a	ιe	•

PO	No	

U INU..

Architect:

Engr:

Rep: (Company)

# LS090HSV5

## Single Zone Dual Cool Wall Mount

Outdoor Unit (ODU) - LSU090HSV5, Indoor Unit (IDU) - LSN090HSV5

## **Performance:**

Cooling Capacity	
(Min~Rated~Max) (Btu/h)	1,023 ~ 9,000 ~ 12,625
SEER	23.5
EER	14.52
SEER - Seasonal Energy Efficiency Ratio	EER - Energy Efficiency Ratio

#### Heating:

Heating Capacity	
(Min~Rated~Max) (Btu/h)	1,023 ~ 10,900 ~ 17,061
HSPF	11.3
Max. Heating @ Indoor 70°F DB	
Outdoor 19°F DB / 17°F WB	11,080 (102%)
Outdoor 6°F DB / 5°F WB	9,570 (88%)
Outdoor -3°F DB / -4°F WB	8,310 (76%)
HSPF - Heating Seasonal Performance Factor	
Cooling Nominal Test Conditions:	Heating Nominal Test Conditions:

Indoor: 80°F DB / 67°F WB Outdoor: 95°F DB / 75°F WB

#### Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB

#### **Outdoor Unit:**

MOP (A)		15
MCA (A)		10
Cooling / Heating Rated Amps (A)		7.4 / 7.4
Compressor (A)		7
Fan Motor (A)		0.4
MOP - Maximum Overcurrent Protection	MCA - Minimum Circuit Ampacity	

### **Total Power Input:**

Cooling Power Input (kW)	0.62
Heating Power Input (kW)	0.71

#### **Piping:**

1 0	
Liquid Line (in., O.D.)	ø1/4
Vapor Line (in., O.D.)	ø3/8
Additional Refrigerant (oz./ft.)	0.22
Min. / Max. Pipe Length (ft.) <sup>2</sup>	9.8 / 82
Piping Length (no add'l refrig., ft.)	41
Max. Elevation (ft.)	49.2

### **Controls Features:**

<ul> <li>24-Hour on/off timer</li> <li>4-Way auto swing</li> <li>Auto changeover</li> <li>Auto restart</li> <li>Jet cool/Jet heat</li> <li>Built-in low ambient standard, down to 14°F (cooling mode)</li> </ul>	Condensate Sensor Connection     Inverter (variable speed compressor)     IDU compatible with Multi F ODUs     Smart Diagnosis     3M Micro Filter	<ul> <li>Self-cleaning indoor coil</li> <li>Sleep mode</li> <li>Cooling only function</li> <li>Built-in Wi-Fi via Smart ThinQ app</li> <li>Built-in base pan heater (9/12k; optional for 18k)</li> </ul>
--	---	--

#### **Optional Accessories:**

	AC Smart IV BACnet <sup>®</sup> Gateway -
MultiSITE CRC1+ - PREMTBVC1	PBACNA000
Standard RS3 Controller- PREMTB100	Base Pan Heater for 18k - PQSH1201
PI-485 - PMNFP14A1	Low Ambient Kit (Cooling operation to
Thermostat Dry Contact - PDRYCB320	-40°F) - PAG-HS0/PAG-HS3/PQCA0
LonWorks <sup>®</sup> Gateway - PLNWKB100	Without PQCA0 (Baffles only) Cooling to 0°F

For a complete list of available accessories, contact your LG representative.

© LG Electronics Canada, Inc., North York, ON. All rights reserved. "LG Life's Good" is a registered trademark of LG Corp. /www.lgdfs.ca



Resubmit

Other\_

For:

GC:

Mech:

(Project Manager)

File

Approval





## **Operating Range:**

Tag #:

14 ~ 118
-4 ~ +65
53 ~ 75
60 ~ 86
208-230/60/1
R410A
EEV
2.21
45 / 48
39 / 33 / 23 / 19
39 / 33 / 23
74.1 / 78.9
18.3 / 23.4
GoldFin™
Propeller
Cross Flow
6/6/6
1+1
Brushless Digitally Controlled/Direct
1,165
459 / 338 / 317 / 194
459 / 338 / 317 / 229
2.7

Notes:
1. Acceptable operating voltage: 187V-253V.
2. Piping lengths are equivalent.
3. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
4. All communication / connection (power) cable from the outdoor unit to the indoor unit is field supplied and must be a minimum of four-conductor, 18 AWG, stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit on unit, and must comply with applicable local and national codes.
5. See Engineering Manual for sensible and latent capacities.
6. Power wiring cable size must comply with the applicable local and national code.
7. The indoor unit comes with a dry helium charge.
8. This data is rated 0 ft. above sea level, with 24.6 ft. of refrigerant line and a 0 ft. level difference between outdoor and indoor units.


This data is faced of it. above sea level, with 24.6 it. or lengerant line and a of it, level difference between outdoor and indoor units.
 Must follow installation instructions in the applicable LG installation manual.
 Must follow installation is LIDUs include socket adapters for refrigerant pipe connections with Multi F systems. BACnet® is a registered trademark of ASHRAE. LonWorks® is a trademark of Echelon Corporation.

11. If optional low ambient kit (PAG-HS0/PAH-HS3) is used, one wind baffle per ODU fan is used.






SB\_SZ\_HiEff\_Std\_WallMount\_LS090HSV5\_2018\_03\_20\_055630 Page 1 of 3

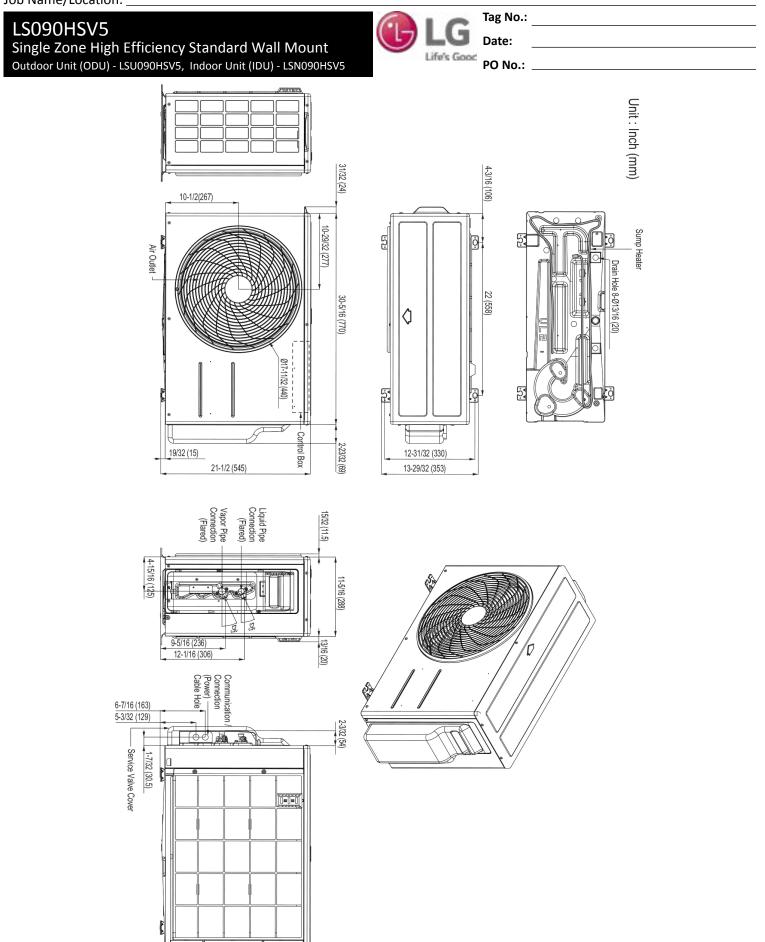

For continual product development, LG reserves the right to change specifications without notice. © LG Electronics Canada, Inc., North York, ON. All rights reserved. "LG Life's Good" is a registered trademark of LG Corp. /www.lgdfs.ca

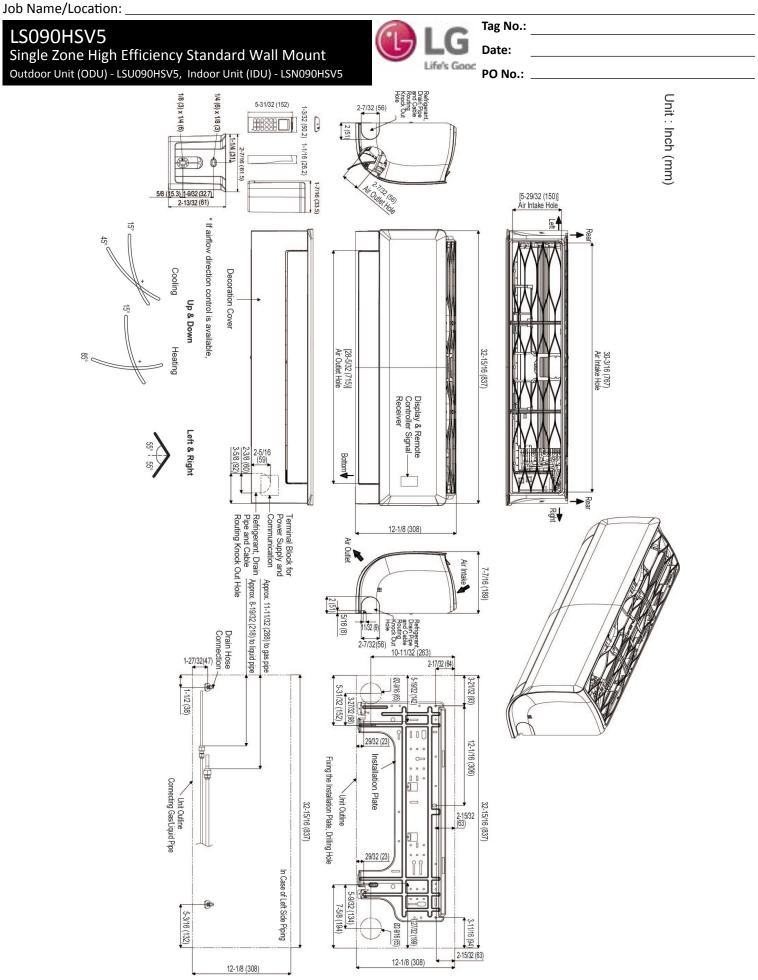

For continual product development, LG reserves the right to change specifications without notice. © LG Electronics Canada, Inc., North York, ON. All rights reserved. "LG Life's Good" is a registered trademark of LG Corp. /www.lgdfs.ca