Job Name/Location: Tag #: For: File Resubmit Date: **Approval** Other. PO No.: GC: Architect: Mech: Engr: Rep: (Project Manager) LA180HSV5 Single Zone Art Cool Mirror Wall Mount Outdoor Unit (ODU) - LSU180HSV5, Indoor Unit (IDU) - LAN180HSV5 Performance: **Operating Range:** Cooling: **Outdoor Unit: Cooling Capacity** 3,070 ~ 18,000 ~ 29,515 (Min~Rated~Max) (Btu/h) 21.5 Indoor Unit **EER** 12.58 SEER - Seasonal Energy Efficiency Ratio EER - Energy Efficiency Ratio Heating: **Electrical: Heating Capacity** (Min~Rated~Max) (Btu/h) 3,070 ~ 21,600 ~ 38,898 **HSPF System Data:** 10.2 Max. Heating @ Indoor 70°F DB 22,340 (103%) Outdoor 19°F DB / 17°F WB

19,300 (89%)

16,760 (77%)

Outdoor 6°F DB / 5°F WB Outdoor -3°F DB / -4°F WB HSPF - Heating Seasonal Performance Factor

Cooling Nominal Test Conditions: Indoor: 80°F DB / 67°F WB Outdoor: 95°F DB / 75°F WB

Heating Nominal Test Conditions: Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB

Outdoor Unit:

MOP (A)	20
MCA (A)	13
Cooling / Heating Rated Amps (A)	9.85 / 9.85
Compressor (A)	9.6
Fan Motor (A)	0.25
MOP - Maximum Overcurrent Protection	MCA - Minimum Circuit Amnacity

Total Power Input:

Cooling Power Input (kW)	1.43
Heating Power Input (kW)	1.73

Piping:

Liquid Line (in., O.D.)	ø3/8
Vapor Line (in., O.D.)	ø5/8
Additional Refrigerant (oz./ft.)	0.38
Min. / Max. Pipe Length (ft.) ²	9.8 / 114.8
Piping Length (no add'l refrig., ft.)	24.6
Max. Elevation (ft.)	49.2

Controls Features:

- 24-Hour on/off timer
- 4-Way auto swingAuto changeover
- Auto restart
- Jet cool/Jet heatBuilt-in low ambient standard, down to 14°F (cooling mode)
- Condensate Sensor
- Connection • Inverter (variable speed
- compressor)
- IDU compatible with Multi F ODUs
- Smart Diagnosis
 3M Micro Filter
- Self-cleaning indoor coil
- Sleep mode
- Cooling only function
 Built-in Wi-Fi via Smart
- ThinQ app
- (9/12k; optional for 18k)

Built-in base pan heater

Optional Accessories:

☐ MultiSITE™ CRC1 - PREMTBVC0	☐ AC Smart IV BACnet® Gateway -
☐ MultiSITE CRC1+ - PREMTBVC1	PBACNA000
☐ Standard RS3 Controller-PREMTB100	☐ Base Pan Heater for 18k - PQSH
☐ PI-485 - PMNFP14A1	☐ Low Ambient Wind Baffle Kit (C
Dry Contact - PDRYCB320	to -40°F) - PAG-HS8, PAG-HS2, I

ater for 18k - PQSH1201 t Wind Baffle Kit (Cooling to -40°F) - PAG-HS8, PAG-HS2, PQCAO ☐ LonWorks® Gateway - PLNWKB100 Without PQCA0 (Baffles only) Cooling to 0°F





Cooling (°F DB)	14 ~ 118
Heating (°F WB)	-4 ~ +65

THE COURSE STORY MEASURE

mader onit.	
Cooling (°F WB)	53 ~ 75
Heating (°F DB)	60 ~ 86

Power Supply (V¹/Hz/Ø)	208-230/60/1
------------------------	--------------

Refrigerant Type	R410A
Refrigerant Control	EEV
Refrigerant Charge (lbs.)	3.53
ODU Sound Pressure	
(Cooling / Heating) (±3 dB[A]) ³	53 / 53
IDU Sound Pressure	
Cooling (H/M/L/Sleep) (±3 dB[A]) ³	45 / 40 / 35 / 29
Heating (H/M/L) (±3 dB[A]) ³	45 / 40 / 35
ODU Net / Shipping Weight (lbs.)	116.8 / 126.5
IDU Net / Shipping Weight (lbs.)	29.8 / 36.4
Heat Exchanger Coating	GoldFin™

Fan:

ODU Type	Propeller
IDU Type	Cross Flow
Fan Speeds (Fan/Cool/Heat)	6/6/6
Quantity (ODU + IDU)	1+1
Motor/Drive	Brushless Digitally Controlled/Direct
ODU Max. Air Flow Rate (CFM)	2,119
IDU Air Flow	
Cooling, Max/H/M/L (CFM)	706 / 530 / 477 / 371
Heating, Max/H/M/L (CFM)	706 / 547 / 494 / 371
Dehumidification (pts./hr.)	5.5

Notes:

- Acceptable operating voltage: 187V-253V.
 Piping lengths are equivalent.
 Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
- A. All communication / connection (power) cable from the outdoor unit to the indoor unit is field supplied and is to be minimum four-conductor, 18 AWG, stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only), and must comply with applicable local and national codes.

 5. See Engineering Manual for sensible and latent capacities.

 6. Power wiring cable size must comply with the applicable local and national code.

 7. The indoor unit comes with a dry helium charge.

 8. This data is rated 0 ft. above sea level, with 24.6 ft. of refrigerant line and a 0 ft. level difference between

- 9. Must follow installation instructions in the applicable LG installation manual.

 10. Multi compatible 18k IDUs include socket adapters for refrigerant pipe connections with Multi F systems.
- BACnet® is a registered trademark of ASHRAE. LonWorks® is a trademark of Echelon Corporation


LA180HSV5

Single Zone Art Cool Mirror Wall Mount
Outdoor Unit (ODU) - LSU180HSV5, Indoor Unit (IDU) - LAN180HSV5



Tag No.: ______
Date: _____

PO No.:

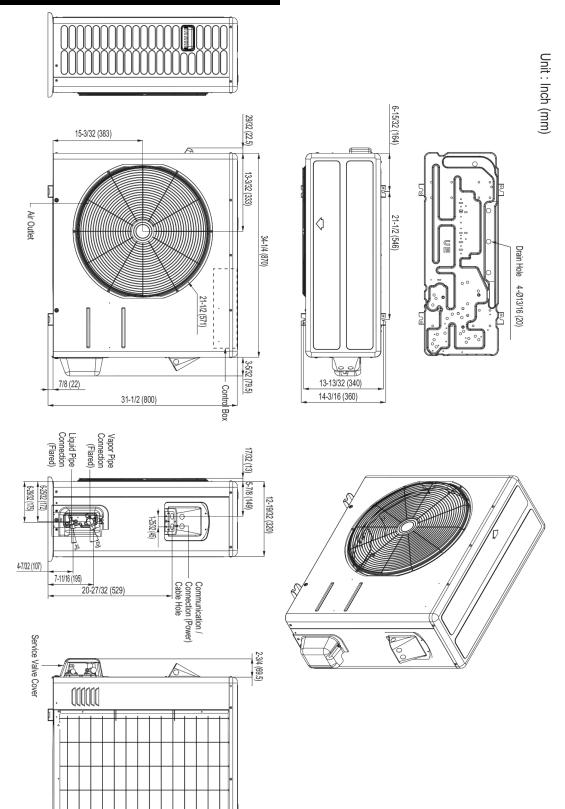

LA180HSV5

Single Zone Art Cool Mirror Wall Mount
Outdoor Unit (ODU) - LSU180HSV5, Indoor Unit (IDU) - LAN180HSV5



Tag No.: ______

Date: _____

