
Job Name/Location:				Tag #:	
Date:		For: File	Resubmit		
		Approval	Other	C LG	
PO No.:		177		LG	
Architect:	GC:				
Engr:	Mech):			
Rep:					
(Company)	(Project N	anager)			LG
LV241HHV4 Single Zone LGRED° Vertica Outdoor Unit (ODU) - LUU240HHV			Life's Good		BOUNTER
Performance:			Operating Range:		
Cooling:			Outdoor Unit:		
Cooling Capacity (Min~Rated~Max, E SEER2 / EER2	3tu/h) 9,600 ~ 24	,000 ~ 30,000 16.45 / 11.90	Cooling (°F DB)		5 to 118
SEER - Seasonal Energy Efficiency Ratio	EER - Energy Efficiency Ratio	10.45 / 11.90	Heating (°F WB)		-13 to 64
Heating:			Indoor Unit:		
Heating Capacity (Min~Rated~Max,	Btu/h) 10,800 ~ 27	7,000 ~ 36,000	Cooling (°F WB)		57 to 77 59 to 81
HSPF2 Max heating @ Indoor 70° DB (Btu/h	.)	9.25	Heating (°F DB)		371001
Outdoor 17°F WB	1)	29,500	System Data: Refrigerant Type/Co		R410A / EEV
Outdoor 5°F WB*		24,200	Refrigerant Charge		4.41
Outdoor -4°F WB		24,250	_	re Max (Cool / Heat) ±1 dB(A) ³	51 / 52
Outdoor -13°F WB HSPF - Heating Seasonal Performance Factor		21,590		e (H/M/L) ±1 dB(A) ³	36 / 34 / 30
* The Capacities at 5°F does not refer to H42 testing co- Cooling Nominal Test Conditions:	nditions. Heating Nominal Test Condition	s:	ODU Net / Shipping		133.4 / 144.4
Indoor: 80°F DB / 67°F WB Outdoor: 95°F DB / 75°F WB	Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB		IDU Net / Shipping	Weight (lbs.)	116.8 / 128.5
Electrical:	20	0 220 / 60 / 4	Fan:		
Power Supply ¹ (V/Hz/Ø) MOP / MCA (A)	20	8-230 / 60 / 1 30 / 22	ODU / IDU Fan Typ		Propeller / Sirocco
Cooling / Heating Rated Amps (A)		8.4 / 8.4	Fan Speeds (Fan/Co		3/3/3 1+1
Compressor(A)		14.5	Fan Quantity (ODU Motor/Drive	וטטו + דו) Electronically Commutated M	
Fan Motor (IDU + ODU) (A)		0.6 + 1.6	Maximum ODU Air	•	2,048
Cooling Power Input (Min~Rated~Ma	, ,	55 ~ 2.02 ~ 3.0		, ,	710 / 640 / 480
Heating Power Input (Min~Rated~M	ax, kW) 0.6	55 ~ 2.35 ~ 4.4	IDU Air Volume (H		4.2
Locked Rotor Amps (A)	NACA Minimum Circuit Amaga	23	Dehumidification F	Pressure Operating	4.2
MOP - Maximum Overcurrent Protection Piping:	MCA - Minimum Circuit Ampaci		Range (Min~Defau		0.1~ - ~0.7
Installed Liquid Pipe (in., O.D.)		3/8 Flare	Notes:		
Installed Vapor Pipe (in., O.D.) IDU Liquid Connection (in., O.D.)		5/8 Flare 1/4 Flare	Acceptable operating very strong very	oltage: 187V-253V.	
IDU Vapor Connection (in., O.D.)		1/2 Flare	Piping lengths are equivalent in a super length are equivalen	valent. ire tested in an anechoic chamber under I	ISO Standard 3745.
Additional Refrigerant (oz./ft.)		0.43	conductor, stranded, shiel	ion cable to be minimum 14 American wir Ided or unshielded wire and must comply	with applicable local and
Min/Max. Pipe Length (ft.)		16.4 / 164	5. Power wiring cable size	the wire must be grounded to the chassis must comply with the applicable local an with a dry helium charge. bove sea level, with 25 ft. of refrigerant lin	id national code.
Piping Length (no add'l refrig., ft.)		24.9			
Max. Elevation (ft.)		98.4	 Must follow installation Dehumidification rate is 	n instructions in the applicable LG installat s based on high speed airflow. units have ECM fan that automatically adj	ion manual.
Features:			10. 18k, 24k, and 36k IDU (External Static Pressure)	units have ECM fan that automatically adj range. Therefore, there is no default ESP v e supplied with socket adapters for pipe tr	justs throughout the ESP value for these units.
Hot start Inverter (variable speed) Auto restart Control lock W2 terminal connection Group control in timer (on/or Sleep Mode Optional Wiese) Built in dry or Sleep Mode Optional Wiese)	ff) • Night Qu -Fi Control	n Pan Heater iet Function	Controller not include	ed. sory available in 3kW, 5kW, 8kW, and 10k	
Required Accessories (sold separ					
Controller (Any LG wired remote controlle	er)				
Optional Accessories: ☐ MultiSITE™ CRC2 - PREMTBVC2 [AC Smart 5 - PACS5A	100			
Progrmmable Remote Controller -	Low Ambient Kit -40°l	cooling			
PREMTB100 Delux Remote Controller - [PQCA0, PAG-HS6/PAG Without PQCA0 Cooli				
PREMTB200	Wi-Fi Module - PWFN				
☐ Dry Contact 3rd Party Thermostat ☐ Electric Heater ¹³	- PDRYCB320		LCDES		ALE CERTIFIED®
Remote Temperature Sensor - ZRTBS0	1		LGKEL	Inverter Sh	www.ahridirectory.org






Job Name/Location:

LVN241HV4 Single Zone LGRED° Vertical Air Handler Unit




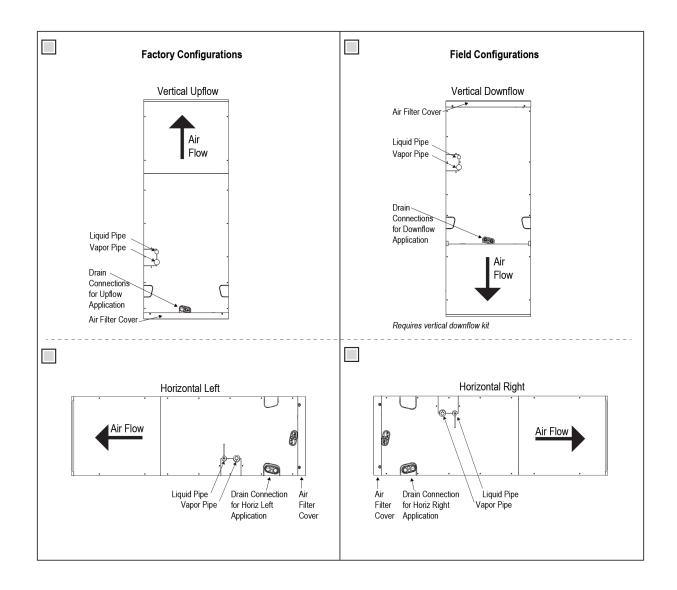



Job Name/Location:


LUU240HHV Single Zone LGRED° Vertical Air Handler Unit

		Tag No.:	
リ	LG	Date:	
	Life's Good	DO No .	



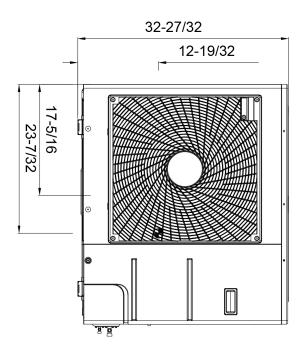

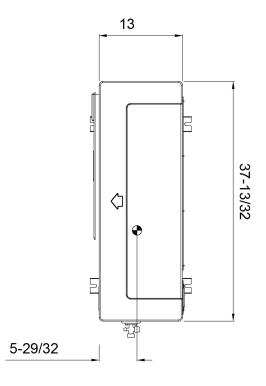



Job Name/Location:

LVN241HV4


Single Zone LGRED° Vertical Air Handler Unit








PO No.:



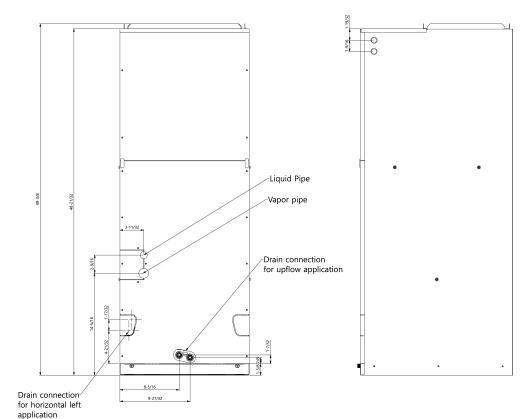

Front View

Side View