
Job Name/Location:					Tag #:	
Date:		For:	File	Resubmit		
PO No.:			Approval	Other	• (b) LG	
Architect:	GC:					⊕ LG
Engr: Mech:						
Rep:		··				
(Company)	(Project M	lanager)				24 ,
LV480HHV Single Zone LGRED° Vertical Air Outdoor Unit (ODU) - LUU480HHV Indoor				Life's Good		
Performance: Cooling:				Operating Rang	зе :	
Cooling Capacity (Min~Rated~Max, Btu/h)	18,400 ~ 46	,000 ~ 5	5,000	Outdoor Unit:		
\$EER2 / EER2		17.75 /		Cooling (°F DB) Heating (°F WB)		5 to 118 -13 to 64
SEER - Seasonal Energy Efficiency Ratio EER - Ene Heating:	rgy Efficiency Ratio			Indoor Unit:		
Heating Capacity (Min~Rated~Max, Btu/h)	19,000 ~ 50	0.000 ~ 6	3.000	Cooling (°F WB)		57 to 77
HSPF2	. , , 0 0 0	,,000	9.40	Heating (°F DB)		59 to 81
Max heating @ Indoor 70° DB (Btu/h)		5	3,700	System Data:	,	
Outdoor 17°F WB Outdoor 5°F WB			0,500	Refrigerant Type		R410A / EEV
Outdoor -4°F WB		3	9,960	Refrigerant Char	rge (IDS.) Ssure Max (Cool / Heat) ±1 dB(A) ³	9.26 54 / 56
Outdoor -13°F WB		3.	4,990		sure (H/M/L) ±1 dB(A) ³	49 / 48 / 44
HSPF - Heating Seasonal Performance Factor *The Capacities at 5°F does not refer to H42 testing conditions. Cooling Nominal Test Conditions: Heating N	Iominal Test Condition			ODU Net / Shipp		210.9 / 234.1
Indoor: 80°F DB / 67°F WB Indoor: 70	0°F DB / 60°F WB	5.		IDU Net / Shippi	ng Weight (lbs.)	158.7 / 176.4
Outdoor: 95°F DB / 75°F WB Outdoor: Electrical:	47°F DB / 43°F WB			Fan:		
Power Supply¹ (V/Hz/Ø)	20	8-230 /		ODU / IDU Fan 1	Гуре Prop	oeller / Sirocco
MOP / MCA (A) Cooling / Heating Rated Amps (A)		16.3	0 / 32 / 17 1	Fan Speeds (Fan		3/3/3
Compressor(A)		10.07	22.0	Fan Quantity (O	· · · · · · · · · · · · · · · · · · ·	2 + 1
Fan Motor (IDU + ODU) (A)		1.3 + (1.	6 x 2)	Motor/Drive	Brushless Digitally Cont	
Cooling Power Input (Min~Rated~Max, kW)	1.4	l ~ 3.85 ~	- 5.73		Air Volume (CFM)	4,238
Heating Power Input (Min~Rated~Max, kW)	1.	.4 ~ 3.83		IDU Air Volume		/ 1,260 / 1,000
Locked Rotor Amps (A)			33	Dehumidificatio	on Rate (pts/nr) ³ atic Pressure Operating	7.54
MOP - Maximum Overcurrent Protection MCA - Mi Piping:	nimum Circuit Ampaci	ty			fault~Max) (in-wg) ¹⁰	0.1~ 0.3 ~ 1.0
Installed Liquid Pipe (in., O.D.)		3/8 [Notes		
Installed Vapor Pipe (in., O.D.) IDU Liquid Connection (in., O.D.)		5/8 I 3/8 I		Notes: 1. Acceptable operating	ng voltage: 187V-253V.	
IDU Vapor Connection (in., O.D.)		5/8 I		Piping lengths are e Sound Pressure leve A All power/sommuni	rg voltage: 357 v 255v. els are tested in an anechoic chamber under ISO Star igation cable to be minimum 14 American wire gage	ndard 3745.
Additional Refrigerant (oz./ft.)			0.43	conductor, stranded, s national code. If shield	ication cable to be minimum 14 American wire gage shielded or unshielded wire and must comply with a ded, the wire must be grounded to the chassis at the	oplicable local and outdoor unit only.
Min/Max. Pipe Length (ft.)		16.4 /	246	Power wiring cableThe indoor unit com	ded, the wire must be grounded to the chassis at the size must comply with the applicable local and natio nes with a dry helium charge. ft. above sea level, with 25 ft. of refrigerant line and	nal code.
Piping Length (no add'l refrig., ft.)			24.9	airrerence between oi	ft. above sea level, with 25 ft. of refrigerant line and a utdoor and indoor units. Ition instructions in the applicable LG installation mai	
Max. Elevation (ft.)		(98.4		te is based on high speed airflow. IDU units have ECM fan that automatically adjusts thr	
☐ Progrmmable Remote Controller - ☐ Low A		iet Function	on	(External Static Pressu 11. 18k and 24k VAHU 12. Electric heater acc	ire) range. Therefore, there is no default ESP value to is are supplied with socket adapters for pipe transition cessory available in 3kW, 5kW, 8kW, 10kW, 15kW, a ne engineering manual for details.	or these units. ns.
☐ Delux Remote Controller - ☐ Without	out PQCA0 Coolir Module - PWFM	ng to 0°F				
☐ Dry Contact 3rd Party Thermostat - PDRYC		טעטטוטעני				
☐ Electric Heater ¹¹ ☐ Remote Temperature Sensor - ZRTBS01				IGRF	Invortor CD.	CERTIFIED® www.ahridirectory.org
Downflow Conversion Kit - PNDFK0					Unitary Str. AHRI Star	mall HP ndard 210/240






Job Name/Location:

LVN480HV Single Zone LGRED° Vertical Air Handler Unit




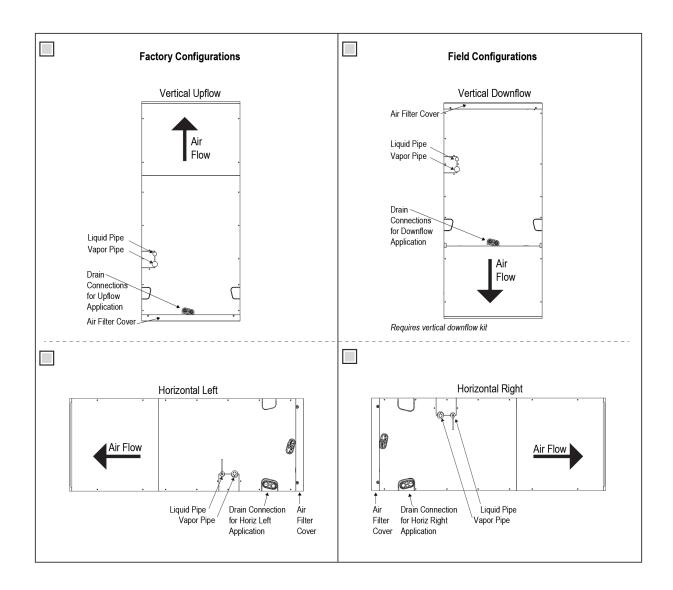



Job Name/Location:


LUU480HHV Single Zone LGRED° Vertical Air Handler Unit










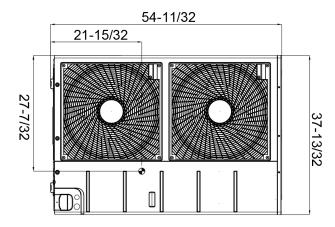









Unit: inch

Job Name/Location:

LVN480HV Single Zone LGRED° Vertical Air Handler Unit



Tag No.:	
Date:	

