Job Name/Location:			Tag #:	
Date:	For: File	Resubmit		
PO No.:	Approval	Other	C C LG	
Architect: GC:				C LG
Engr: Mech:				
	•			
Rep: (Company) (Project M.	anager)			
LV361HHV4 Single Zone LGRED° Vertical Air Handler Un Outdoor Unit (ODU) - LUU360HHV Indoor Unit (IDU) - LVN		LG Life's Good		
Performance:		Operating Range:		
Cooling:	,000 ~ 44,000	Outdoor Unit:		
, , , ,	16.40 / 11.95	Cooling (°F DB)		5 to 11
SEER - Seasonal Energy Efficiency Ratio EER - Energy Efficiency Ratio	10.107 11.70	Heating (°F WB)		-13 to 6
Heating:		Indoor Unit: Cooling (°F WB)		57 to 7
	,500 ~ 43,000	Heating (°F DB)		57 to 8
HSPF2 Max heating @ Indoor 70° DB (Btu/h)	9.30			
Outdoor 17°F WB	39,000	System Data: Refrigerant Type/Co		R410A / EE
Outdoor 5°F WB*	33,800	Refrigerant Charge		7.5
Outdoor -4°F WB	33,810		re Max (Cool / Heat) ±1 dB(A) <sup>3</sup>	52/5
Outdoor -13°F WB HSPF - Heating Seasonal Performance Factor	28,140	IDU Sound Pressure		44 / 41 / 39
* The Capacities at 5°F does not refer to H42 testing conditions.  Cooling Nominal Test Conditions: Heating Nominal Test Conditions		ODU Net / Shipping	; Weight (lbs.)	198.9 / 223.
Indoor: 80°F DB / 67°F WB Indoor: 70°F DB / 60°F WB	·	IDU Net / Shipping	Weight (lbs.)	122.4 / 134.0
Outdoor: 95°F DB / 75°F WB Outdoor: 47°F DB / 43°F WB Electrical:		Fan:		
	8-230 / 60 / 1	ODU / IDU Fan Type	e	Propeller / Sirocci
MOP / MCA (A)	40 / 32	Fan Speeds (Fan/Co	ool/Heat)	3/3/
Cooling / Heating Rated Amps (A)	11.7 / 14.9 22.0	Fan Quantity (ODU		2 +
Compressor(A) Fan Motor (IDU + ODU) (A)	1.0 + (1.6 x 2)	Motor/Drive	Electronically Commutated M	otor (ECM) / Direc
	~ 2.76 ~ 4.78	Maximum ODU Air	Volume (CFM)	4,23
	6 ~ 3.40 ~ 4.1	IDU Air Volume (H/	<sup>'</sup> M/L) (CFM)	988 / 883 / 79
Locked Rotor Amps (A)	33	Dehumidification R	ate (pts/hr) <sup>10</sup>	7.
MQP - Maximum Overcurrent Protection MCA - Minimum Circuit Ampacit			Pressure Operating	
Piping:	0.40.51	Range (Min~Defaul	it~Max) (in-wg) <sup>11</sup>	0.1~ - ~0.
Installed Liquid Pipe (in., O.D.) Installed Vapor Pipe (in., O.D.)	3/8 Flare 5/8 Flare	Notes:		
IDU Liquid Connection (in., O.D.)	3/8 Flare	Acceptable operating vo     Pining lengths are equiv	oltage: 187V-253V.	
IDU Vapor Connection (in., O.D.)	5/8 Flare	Sound Pressure levels at     All power/communication	re tested in an anechoic chamber under IS on cable to be minimum 14 American wire	60 Standard 3745.
Additional Refrigerant (oz./ft.)	0.43	conductor, stranded, shiel national code. If shielded,	ded or unshielded wire and must comply the wire must be grounded to the chassis	with applicable local and at the outdoor unit only
Min/Max. Pipe Length (ft.)	16.4 / 246	<ol> <li>Power wiring cable size</li> <li>The indoor unit comes y</li> </ol>	oltage: 187V-253V. ralent. re tested in an anechoic chamber under IS on cable to be minimum 14 American wire ded or unshielded wire and must comply w the wire must be grounded to the chassis must comply with the applicable local and with a dry helium charge. bove sea level, with 25 ft. of refrigerant lin or and indoor units.	d national code.
Piping Length (no add'l refrig., ft.)	24.9	<ol><li>This data is rated 0 ft. ald difference between outdo</li></ol>	pove sea level, with 25 ft. of refrigerant line or and indoor units.	e and a 0 ft. level
Max. Elevation (ft.)	98.4	Must follow installation     Dehumidification rate is	instructions in the applicable LG installation	on manual.
Features:  • Hot start • Inverter (variable speed) • Auto restart • Control lock • W2 terminal connection  Required Accessories (sold separately):  Controller (Any LG wired remote controller)  • Group control • Timer (on/off) • Night Qui • Multi F (18l models)	atible with	12. Controller not include	ory available in 3kW, 5kW, 8kW, and 10k\	
Optional Accessories:	fle Kit PAG-HS4/PAG-HS5 -4°F)		°	ALRI CERTIFIED









Job Name/Location:

## LVN361HV4 Single Zone LGRED° Vertical Air Handler Unit



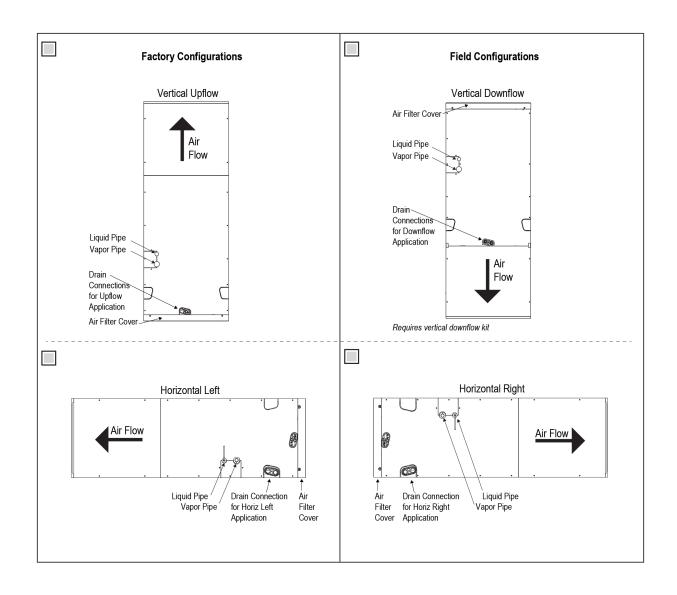



Job Name/Location:


## LUU360HHV Single Zone LGRED° Vertical Air Handler Unit




Tag No.:	
Date:	







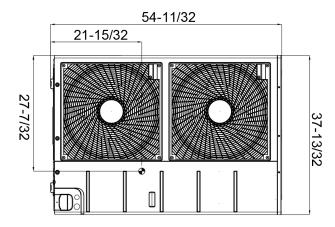









Unit: inch

Job Name/Location:


## LVN361HV4 Single Zone LGRED° Vertical Air Handler Unit








PO No.:



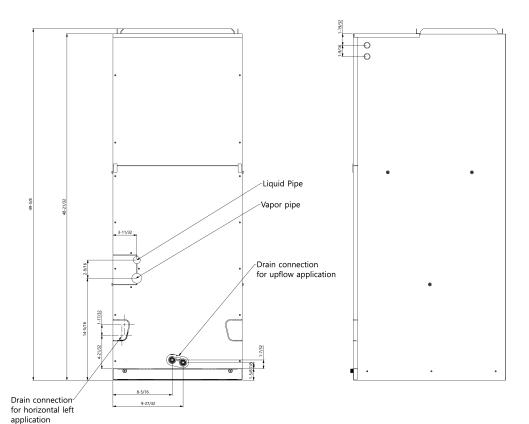

Front View

Side View