
Job Name/Location:				Tag #:
Date:	For:	File	Resubmit	
PO No.:		Approval	Other	€ GLG
Architect: GC:				€ LG
Engr: Mech:				
Rep:				
(Company) (Project N	/lanager)			
LV480HHV Single Zone LGRED° Vertical Air Handler Ur Outdoor Unit (ODU) - LUU480HHV Indoor Unit (IDU) - LV			LIFe's Good	
Performance:			Operating Rang	e:
Cooling:  Cooling Capacity (Min~Rated~Max, Btu/h)  18,400 ~ 46	5 000 - F	55,000	Outdoor Unit:	
SEER2 / EER2	17.75 /		Cooling (°F DB)	5 to 118
SEER - Seasonal Energy Efficiency Ratio EER - Energy Efficiency Ratio			Heating (°F WB) Indoor Unit:	-13 to 6
Heating:	0.000	(0.000	Cooling (°F WB)	57 to 7
Heating Capacity (Min~Rated~Max, Btu/h) 19,000 ~ 50 HSPF2	0,000 ~ 6	9.40	Heating (°F DB)	59 to 8
Max heating @ Indoor 70° DB (Btu/h)	_		System Data:	
Outdoor 17°F WB		53,700 10,500	Refrigerant Type	/Control R410A / EE
Outdoor 5°F WB Outdoor -4°F WB		39,960	Refrigerant Charg	
Outdoor -13°F WB		34,990		sure Max (Cool / Heat) $\pm 1$ dB(A) <sup>3</sup> 54 / 56
HSPF - Heating Seasonal Performance Factor *The Capacities at 5°F does not refer to H42 testing conditions.		,	ODU Net / Shippi	ure $(H/M/L) \pm 1 dB(A)^3$ 49 / 48 / 44
Cooling Nominal Test Conditions: Heating Nominal Test Condition Indoor: 80°F DB / 67°F WB Indoor: 70°F DB / 60°F WB	ns:		IDU Net / Shippir	
Outdoor: 47°F DB / 75°F WB  Electrical:				150.77 170.5
	08-230 /	60 / 1	Fan: ODU / IDU Fan T	ype Propeller / Sirocco
MOP / MCA (A)		10 / 32	Fan Speeds (Fan,	
Cooling / Heating Rated Amps (A)	16.3	/ 17.1	Fan Quantity (OI	, cool, rieut,
Compressor(A)	1 2 . /1	22.0	Motor/Drive	Brushless Digitally Controlled / Direct
Fan Motor (IDU + ODU) (A) Cooling Power Input (Min~Rated~Max, kW)  1.	1.3 + (1 4 ~ 3.85		Maximum ODU /	Air Volume (CFM) 4,238
, ,	.4 ~ 3.83		IDU Air Volume (	(H/M/L) (CFM) 1,400 / 1,260 / 1,000
Locked Rotor Amps (A)	. 1 0.00	33	Dehumidification	n Rate (pts/hr) <sup>9</sup> 7.5 <sup>4</sup>
MOP - Maximum Overcurrent Protection MCA - Minimum Circuit Ampac	ity			tic Pressure Operating
Piping:	2./0	Fla	Range (Min~Defa	ault~Max) (in-wg) <sup>10</sup> 0.1~ 0.3 ~ 1.0
Installed Liquid Pipe (in., O.D.) Installed Vapor Pipe (in., O.D.)		Flare Flare	Notes:	
IDU Liquid Connection (in., O.D.)		Flare	Acceptable operating     Piping lengths are ecceptable	g voltage: 187V-253V. uivalent.
IDU Vapor Connection (in., O.D.)	5/8	Flare	<ol> <li>Sound Pressure level</li> <li>All power/communic</li> </ol>	uivalent. Is are tested in an anechoic chamber under ISO Standard 3745. cation cable to be minimum 14 American wire gage (AWG), 4- nielded or unshielded wire and must comply with applicable local and
Additional Refrigerant (oz./ft.)		0.43	national code. If shield	nielded or unshielded wire and must comply with applicable local and ed, the wire must be grounded to the chassis at the outdoor unit only
Min/Max. Pipe Length (ft.)	16.4		6. The indoor unit com	ed, the wire must be grounded to the chassis at the outdoor unit only ize must comply with the applicable local and national code. es with a dry helium charge. t. above sea level, with 25 ft. of refrigerant line and a 0 ft. level
Piping Length (no add'l refrig., ft.)		24.9	8. Must follow installat	tdoor and indoor units. ion instructions in the applicable LG installation manual.
Max. Elevation (ft.)		98.4	9. Dehumidification rat 10. 18k, 24k, and 36k II	e is based on high speed airflow. DU units have ECM fan that automatically adjusts throughout the ESP e) range. Therefore, there is no default ESP value for these units.
Features:  • Hot start • Inverter (variable speed) • Auto restart • Control lock • W2 terminal connection  Required Accessories (sold separately):  Controller (Any LG wired remote controller)  Optional Accessories:			<ol><li>12. Electric heater acc</li></ol>	essory available in 3kW, 5kW, 8kW, 10kW, 15kW, and 20kW e engineering manual for details.
MultiSITE™ CRC2 - PREMTBVC2  □ Progrmmable Remote Controller - PREMTB100 □ Delux Remote Controller - PREMTB200 □ Wi-Fi Module - PWFN	affle Kit P <i>F</i> o -4°F)	AG-HS4/PAG-HS	5	
☐ Dry Contact 3rd Party Thermostat - PDRYCB320 ☐ Electric Heater <sup>11</sup> ☐ Remote Temperature Sensor - ZRTBS01 ☐ Downflow Conversion Kit - PNDFK0			LGRE	Inverter




☐ Aux Heater relay kit - PRARH1

Job Name/Location:

## LVN480HV Single Zone LGRED° Vertical Air Handler Unit




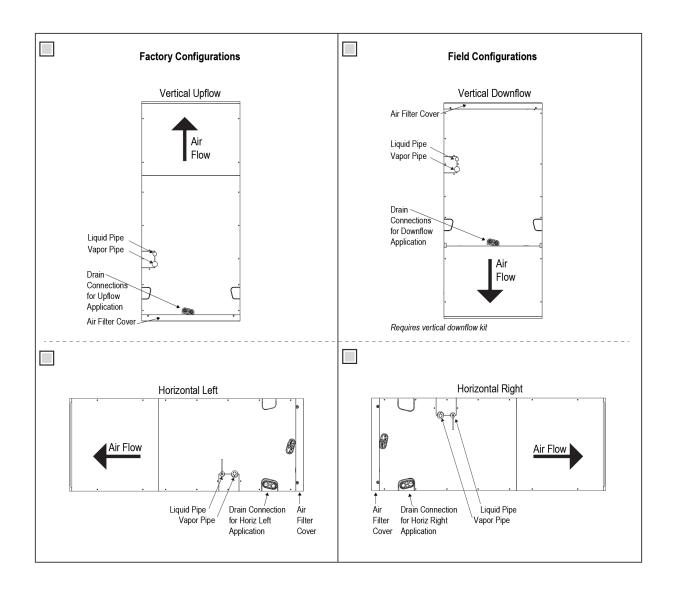



Job Name/Location:


## LUU480HHV Single Zone LGRED° Vertical Air Handler Unit









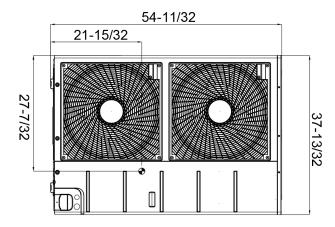









Unit: inch

Job Name/Location:

## LVN480HV Single Zone LGRED° Vertical Air Handler Unit



Tag No.:	
Date:	

